


9.0 Spare Parts Identification

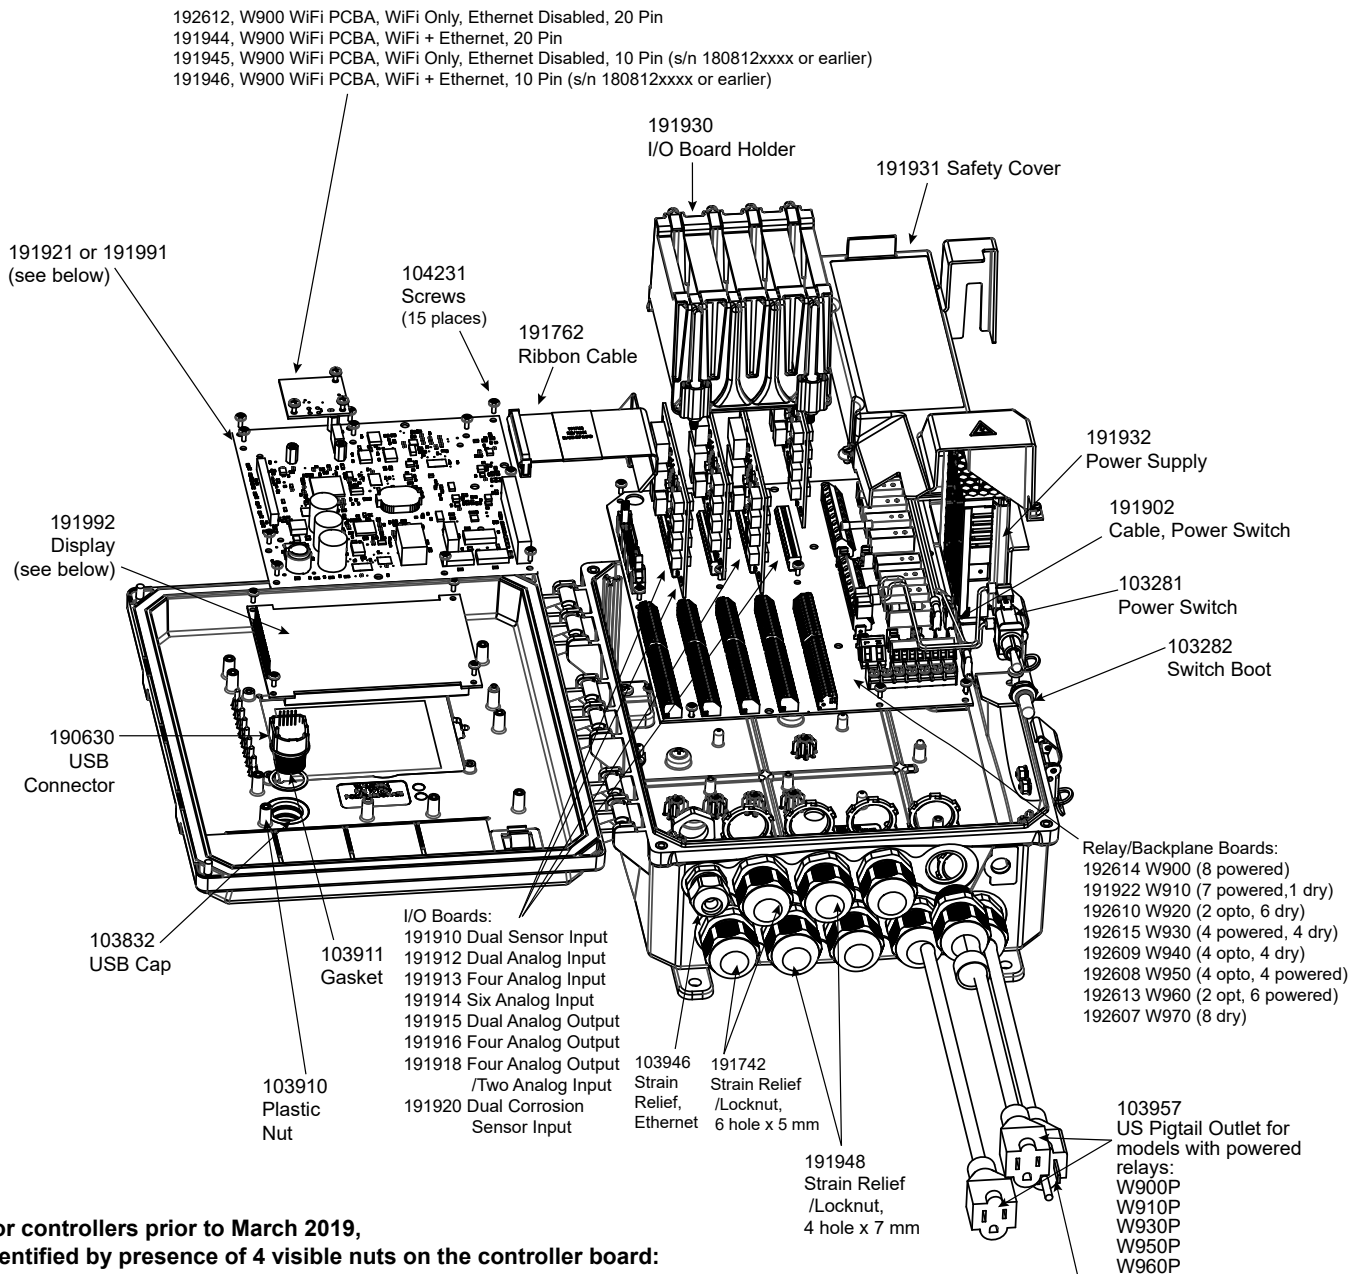

**For controllers prior to March 2019,
 identified by presence of 4 visible nuts on the controller board:**

Order 191921 Controller Board + Display. If also using WiFi, order a new 20-pin WiFi card.

191921-WA-CT-N Cooling tower

191921-WA-BL-N Boiler

191921-WA-IN-N Industrial

Change -N to -M for Modbus or BACnet

**For controllers after to March 2019,
 identified by absence of 4 visible nuts on the controller board:**

191992 Display may be ordered separately from the controller board.

Order 191991 Controller Board. If also using WiFi, that card may be re-used.

191991-WA-CT-N Cooling tower

191991-WA-BL-N Boiler

191991-WA-IN-N Industrial

Change -N to -M for Modbus or BACnet

Controller Parts