

**WALCHEM**

WPH410/420 Controllers

# WPH410/420 Series pH & ORP Controller Instruction Manual

## Notice

© 2008 WALCHEM Corporation  
5 Boynton Road, Holliston, MA 01746 USA  
(508) 429-1110  
All Rights Reserved  
Printed in USA

## Proprietary Material

*The information and descriptions contained herein are the property of WALCHEM Corporation. Such information and descriptions may not be copied or reproduced by any means, or disseminated or distributed without the express prior written permission of WALCHEM Corporation, 5 Boynton Road, Holliston, MA 01746.*

*This document is for information purposes only and is subject to change without notice.*

## Statement of Limited Warranty

*WALCHEM Corporation warrants equipment of its manufacture, and bearing its identification to be free from defects in workmanship and material for a period of 24 months for electronics and 12 months for mechanical parts and electrodes from date of delivery from the factory or authorized distributor under normal use and service and otherwise when such equipment is used in accordance with instructions furnished by WALCHEM Corporation and for the purposes disclosed in writing at the time of purchase, if any. WALCHEM Corporation's liability under this warranty shall be limited to replacement or repair, F.O.B. Holliston, MA U.S.A. of any defective equipment or part which, having been returned to WALCHEM Corporation, transportation charges prepaid, has been inspected and determined by WALCHEM Corporation to be defective. Replaceable elastomeric parts and glass components are expendable and are not covered by any warranty.*

*THIS WARRANTY IS IN LIEU OF ANY OTHER WARRANTY, EITHER EXPRESS OR IMPLIED, AS TO DESCRIPTION, QUALITY, MERCHANTABILITY, FITNESS FOR ANY PARTICULAR PURPOSE OR USE, OR ANY OTHER MATTER.*

180362.A  
August 2008

# TABLE OF CONTENTS

1.0	INTRODUCTION.....	1
2.0	SPECIFICATIONS .....	2
2.1	Measurement Performance.....	2
2.2	Electrical: Input/Output.....	2
2.3	Mechanical .....	3
2.4	WPH Variables and their Limits.....	3
3.0	UNPACKING & INSTALLATION .....	4
3.1	Unpacking the unit.....	4
3.2	Mounting the electronic enclosure.....	4
3.3	Installation .....	4
3.4	Icon Definitions.....	5
3.5	Electrical installation .....	7
4.0	FUNCTION OVERVIEW.....	12
4.1	Front Panel.....	12
4.2	Display .....	12
4.3	Keypad .....	13
4.4	Access Code .....	13
4.5	Startup.....	13
4.6	Shut Down .....	13
5.0	OPERATION.....	14
5.1	Main Menu.....	14
5.2	Sensor Menu .....	16
5.3	Temperature Menu (this menu does not appear if an ORP sensor has been selected) .....	22
5.4	Control 1 and Control 2 Menus (FOR ON/OFF CONTROLLERS).....	23
5.5	Control 1 and Control 2 Menu (FOR PROPORTIONAL CONTROLLERS).....	25
5.6	Auxiliary 1 and 2 Menu.....	27
5.7	4-20 mA Menu (Optional).....	30
5.8	Time Menu.....	31
5.9	Access Code Menu.....	32
5.10	Datalog Menu .....	33
5.11	Config Menu .....	35
5.12	Upgrade Menu.....	37
6.0	MAINTENANCE .....	38
6.1	Electrode Maintenance .....	38
6.2	Replacing the Fuses .....	39
7.0	TROUBLESHOOTING .....	39
7.1	Error Messages .....	39
8.0	SERVICE POLICY .....	41

## 1.0 INTRODUCTION

---

The Walchem WPH400 Series controllers are wall mount pH/ORP controllers that are available in on/off or modulated pulse proportional versions. Two additional relays are available for use as alarms or probe washing. A fifth output is used as a diagnostic alarm. An isolated 4-20 mA output is optional.

They are compatible with any amplified electrode. The choice of pH or ORP operation is selected through the keypad. Use of Antimony pH electrodes is acceptable. Automatic temperature compensation may be used via a Pt1000 or Pt100 input if pH operation is selected. The controller will prompt you to calibrate the electrode at the desired frequency. Automatic buffer recognition may be used in the calibration routine.

Our unique USB feature provides the ability to upgrade the software in the controller to the latest version.

An advanced USB capability option is available. The Config file feature allows you to save all the set points from a controller onto a USB flash disk, and then import them into another controller, making the programming of multiple controllers fast and easy. The data logging feature allows you to save the last 2 month's readings and events to a USB flash disk.

## 2.0 SPECIFICATIONS

---

### 2.1 Measurement Performance

pH Range	-2 to 16 pH units
pH Resolution	0.0015 pH units (0.01 pH displayed)
pH Accuracy (Calibrated):	± .01 pH
ORP Range	-1500 to 1500 mV
ORP Resolution	92 µV (1mV displayed)
ORP Accuracy	±1 mV
Temp Comp (optional):	100 or 1000 ohm platinum RTD
Temperature Range	32-212°F (0-100°C)
Temperature Resolution	±0.09°F (0.05°C)
Temperature Accuracy	± 0.9°F (± 0.5°C)

### 2.2 Electrical: Input/Output

<b>Input Power</b>	100-240 VAC, 50/60 Hz, 8A Fuse: 1.0 ampere, 5 x 20 mm
<b>Input Signals</b>	
pH/ORP	±1500 mV
Temp Comp (optional)	Pt100 or Pt1000
Interlock (optional)	Isolated, dry contact closure required (i.e., flow, level, etc.)
<b>Outputs</b>	
Control 1/2 (ON/OFF)	Internally powered relays switching line voltage 6 A (resistive), 1/8 HP All relays are fused together as one group, total current for this group must not exceed 6A
Control 1/2 (Proportional)	Opto-isolated, Solid State Relay 150mA, 40 VDC Max. VLOWMAX = .13V @ 18 mA
AUX1, AUX2, Alarm	Dry contact relays 6 A (resistive), 1/8 HP
<i>Note:</i> The Alarm relay is non-programmable. Refer to the Main Menu diagram for the list of error conditions that trigger the alarm relay.	
4 - 20 mA (optional)	Internally powered Fully isolated 600 Ohm max resistive load Resolution .001% of span Accuracy ± 1% of reading
pH/ORP Preamp Power	±5 VDC, 5 mA

#### Agency Approvals

UL	ANSI/UL 61010-1:2004, 2 <sup>nd</sup> Edition*
CAN/CSA	C22,2 No.61010-1:2004 2 <sup>nd</sup> Edition*
CE Safety	EN 61010-1 2 <sup>nd</sup> Edition (2001)*
CE EMC	EN 61326 :1998 Annex A*

Note: For EN61000-4-6,-3 the controller met performance criteria B.

\*Class A equipment: Equipment suitable for use in establishments other than domestic, and those directly connected to a low voltage (100-240 VAC) power supply network which supplies buildings used for domestic purposes.

## 2.3 Mechanical

Enclosure Material	Polycarbonate
NEMA Rating	NEMA 4X
Dimensions	8.5" x 6.5" x 5.5"
Display	2 x 16 character backlit liquid crystal
Operating Ambient Temp	32 – 122°F (0 – 50°C)
Storage Temperature	-20 – 180°F (-29 – 80°C)
Flow switch manifold temperature rating	140°F (60°C) max
Flow switch manifold pressure rating	150 psi
Flow switch manifold connections	¾" NPTF

## 2.4 WPH Variables and their Limits

		Low Limit	High Limit
<b>Sensor menu</b>			
	Days Between Calibration	0 days (no reminder)	59 days
<b>Temperature Menu</b>		No variables	
<b>Control 1 &amp; 2 Menus</b>			
	High or Low Set Point	-2 pH, -1500 mV	16 pH, 1500 mV
	Dead Band (WPH410 only)	0 pH, 0 mV	1.99 pH, 199 mV
	Proportional Band (WPH420 only)	0 pH, 0 mV	6.99 pH, 999 mV
	Minimum SPM Rate (WPH420 only)	0 strokes/minute	360 strokes/min
	Maximum SPM Rate (WPH420 only)	0 strokes/minute	360 strokes/min
	Time Limit (set in min:sec)	1 sec	59:59 (enabled) 0=unlimited (disabled)
<b>Auxiliary 1 &amp; 2 Menus</b>			
	High or Low Alarm Point	-2 pH, -1500 mV	16 pH, 1500 mV
	Dead Band	0 pH, 0 mV	1.99 pH, 199 mV
	Hold Time (Probe Wash)	0 seconds	99 seconds
	On Time (Probe Wash)	1 second	99 seconds
<b>4-20 mA Menu</b>	4 & 20 mA Settings	-2 pH, -1500 mV	16 pH, 1500 mV
<b>Access Code Menu</b>	New Value	0	9999
<b>Datalog Menu (Optional)</b>		No variables	
<b>Config Menu (Optional)</b>		No variables	
<b>Upgrade Menu</b>		No variables	

\*Note: The Alarm relay is non-programmable. Refer to the Main Menu diagram for the list of error conditions that trigger the alarm relay.

## 3.0 UNPACKING & INSTALLATION

---

### 3.1 Unpacking the unit

Inspect the contents of the carton. Please notify the carrier immediately if there are any signs of damage to the controller or its parts. Contact your distributor if any of the parts are missing. The carton should contain: a WPH series controller and instruction manual. Any options or accessories will be incorporated as ordered.

### 3.2 Mounting the electronic enclosure

The WPH series controller is supplied with mounting holes on the enclosure. It should be wall mounted with the display at eye level, on a vibration-free surface, utilizing all four mounting holes for maximum stability. Use M6 (1/4" diameter) fasteners that are appropriate for the substrate material of the wall. The enclosure is NEMA 4X rated. The maximum operating ambient temperature is 122°F (50°C); this should be considered if installation is in a high temperature location. The enclosure requires the following clearances:

Top:	2" (50 mm)
Left:	8" (203 mm)
Right:	4" (102 mm)
Bottom:	7" (178 mm)

### 3.3 Installation

Once the enclosure is mounted, the metering pumps or other control devices may be located at any distance from the controller. The electrode, once amplified, may be placed up to 1000 feet from the controller. Shielded cable with twisted pairs is required. Always route AC voltage wiring in conduit that is separated by 6 inches from low voltage DC signal lines (such as the electrode signal).

#### *Electrode Installation*

The WPH controllers are designed to work with most AMPLIFIED pH, ORP or ISE electrodes. When in doubt, follow the electrode manufacturer's instructions for installation.

If you have ordered your controller with an external preamplifier pre-wired to the controller, simply attach the electrode to the BNC connector on the preamplifier. If you are using automatic temperature compensation, wire the ATC element to the preamplifier as shown in figure 3.

If you have ordered the external preamplifier separately, see figure 3 for wiring instructions.

NOTE: The cable between the electrode and the preamplifier is carrying an extremely sensitive high impedance voltage signal. Never cut, splice or otherwise destroy the integrity of the cable or unstable readings and susceptibility to electrical noise will result.

Instructions for physically mounting the electrode into the process solution will vary greatly with the type of electrode and circumstances involved in your application. Here are some general guidelines to assist you. Refer to figure 1, Typical Installation.






The electrode should be installed such that the measuring surfaces will always stay wet. Many electrodes have to be installed vertically, with the measuring surfaces pointing down. Follow the manufacturer's recommendations if this is the case. If the electrode dries out, a slow response and short life will result.

For submersion applications, mount the electrode below the minimum solution level. If the tank will be completely emptied, plan on removing the electrode and storing it in tap water (NOT DI water) or pH 4 buffer solution while the tank is empty. If this is not desirable, a recirculation loop may be installed with the electrode mounted in-line. The WEL electrode cable is not waterproof and must be protected from moisture by connecting a pipe to the top of the electrode housing. The opposite end of the pipe should also be protected from moisture using a cable gland. When submerging the electrode, make sure the cable is protected by a length of pipe, sealed at the top using a cable gland.

For in-line applications, where the electrode is installed in a pipe, the electrode should be placed on the discharge side of the pump (under positive pressure). A "U" trap should be included so that if flow stops, the electrode is still immersed in the solution. If the flow through the pipe can not be shut down for cleaning and calibrating the electrode, install the electrode in a by-pass line with isolation valves to allow for electrode removal. The electrode should be installed in an area where there is good solution movement and where it will respond rapidly to chemical additions. The placement of the electrode relative to the placement of chemical replenishment, along with the quality of the mixing and replenishment flow rate, is critical to accurate control.



**IMPORTANT:** To avoid cracking the female pipe threads on the supplied plumbing parts, use no more than 3 wraps of Teflon tape and thread in the pipe FINGER tight plus 1/2 turn! ***Do not use pipe dope to seal the threads of the flow switch because the clear plastic will crack!***

### 3.4 Icon Definitions

Symbol	Publication	Description
	IEC 417, No.5019	Protective Conductor Terminal
	IEC 417, No. 5007	On (Supply)
	IEC 417, No. 5008	Off (Supply)
	ISO 3864, No. B.3.6	Caution, risk of electric shock
	ISO 3864, No. B.3.1	Caution



### Installation with Submersion Electrode

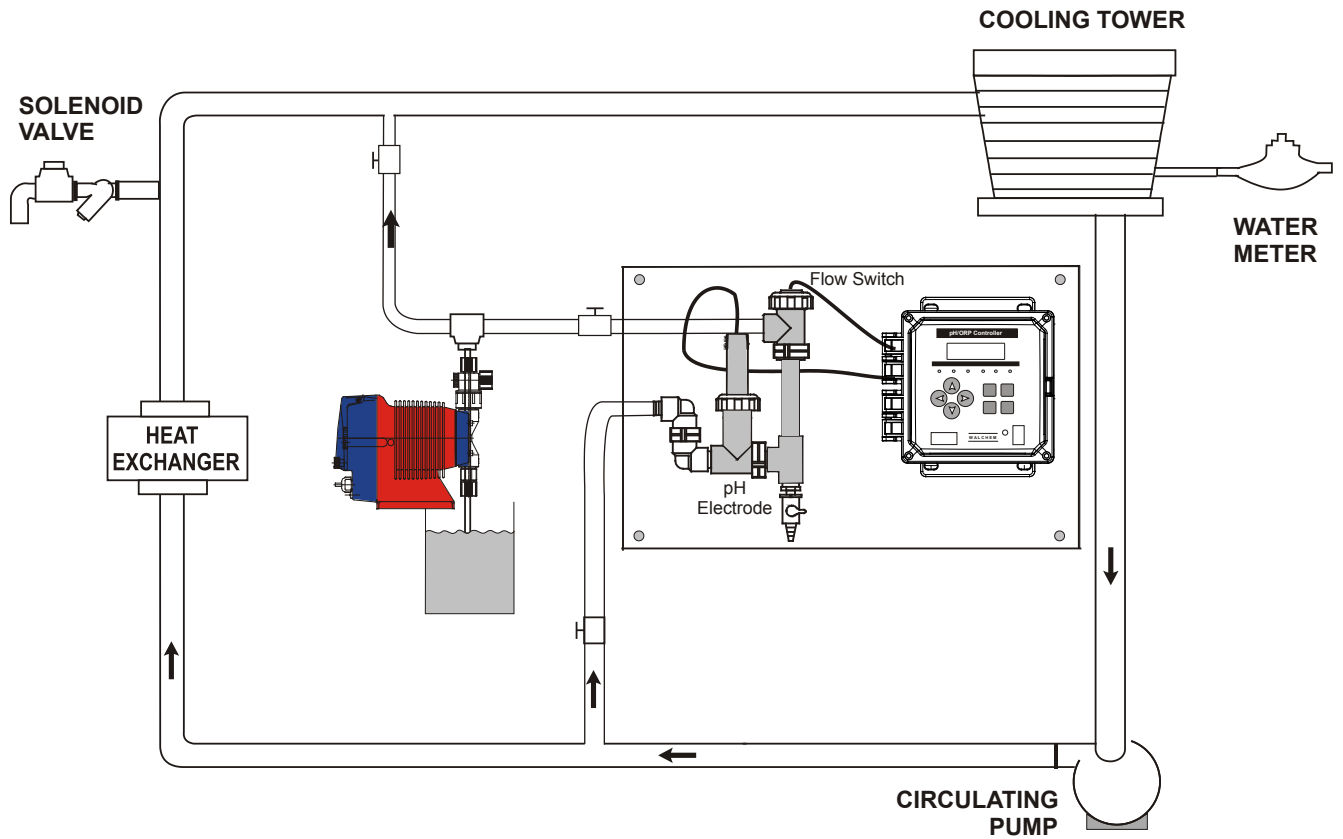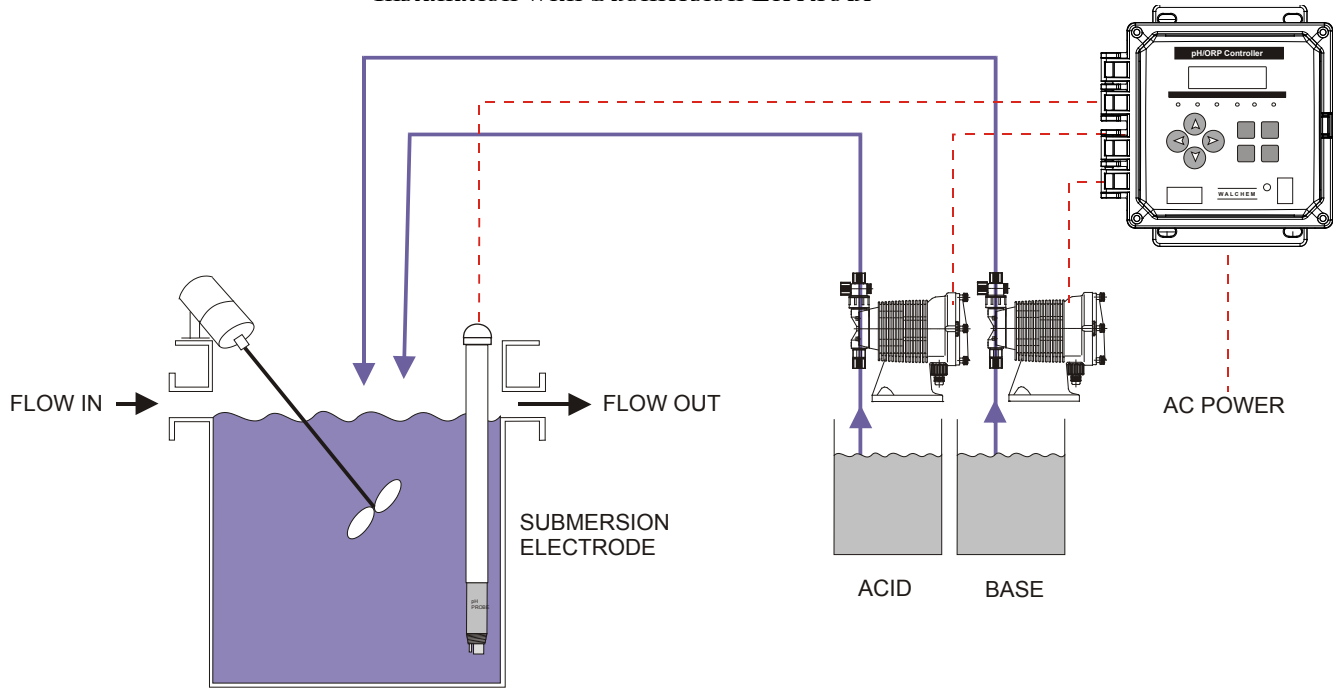


### Installation with In-line electrode

**Figure 1 Typical Installation**


### 3.5 Electrical installation

The various standard wiring options are shown in figure 2. Your WPH series controller will arrive from the factory prewired or ready for hardwiring. Depending on your configuration of controller options, you may be required to hardwire some or all of the input/output devices. Refer to figures 3 and 4 for circuit board layout and wiring.


Note: when wiring the optional 4-20 mA output or a remote interlock switch, it is advisable to use stranded, twisted, shield pair wire between 22-26 AWG. Shield should be terminated at the controller ground stud (see figures 3 and 4).




## CAUTION



1. There are live circuits inside the controller even when the power switch on the front panel is in the OFF position! The front panel must never be opened before power to the controller is REMOVED!  
If your controller is prewired, it is supplied with a 8 foot, 18 AWG power cord with USA style plug. A tool (#1 Phillips driver) is required to open the front panel.
2. When mounting the controller, make sure there is clear access to the disconnecting device!
3. The electrical installation of the controller must be done by trained personnel only and conform to all applicable National, State and Local codes!
4. Proper grounding of this product is required. Any attempt to bypass the grounding will compromise the safety of persons and property.
5. Operating this product in a manner not specified by Walchem may impair the protection provided by the equipment.

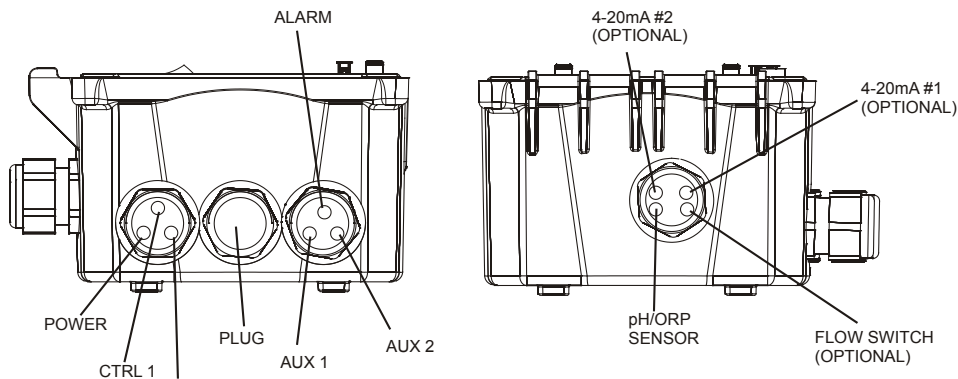

**Figure 2a WPH410 Conduit Wiring**

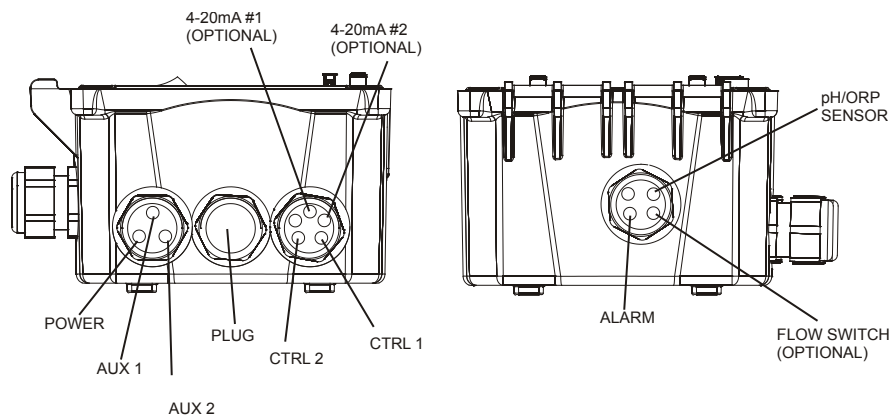

**Figure 2b WPH420 Conduit Wiring**



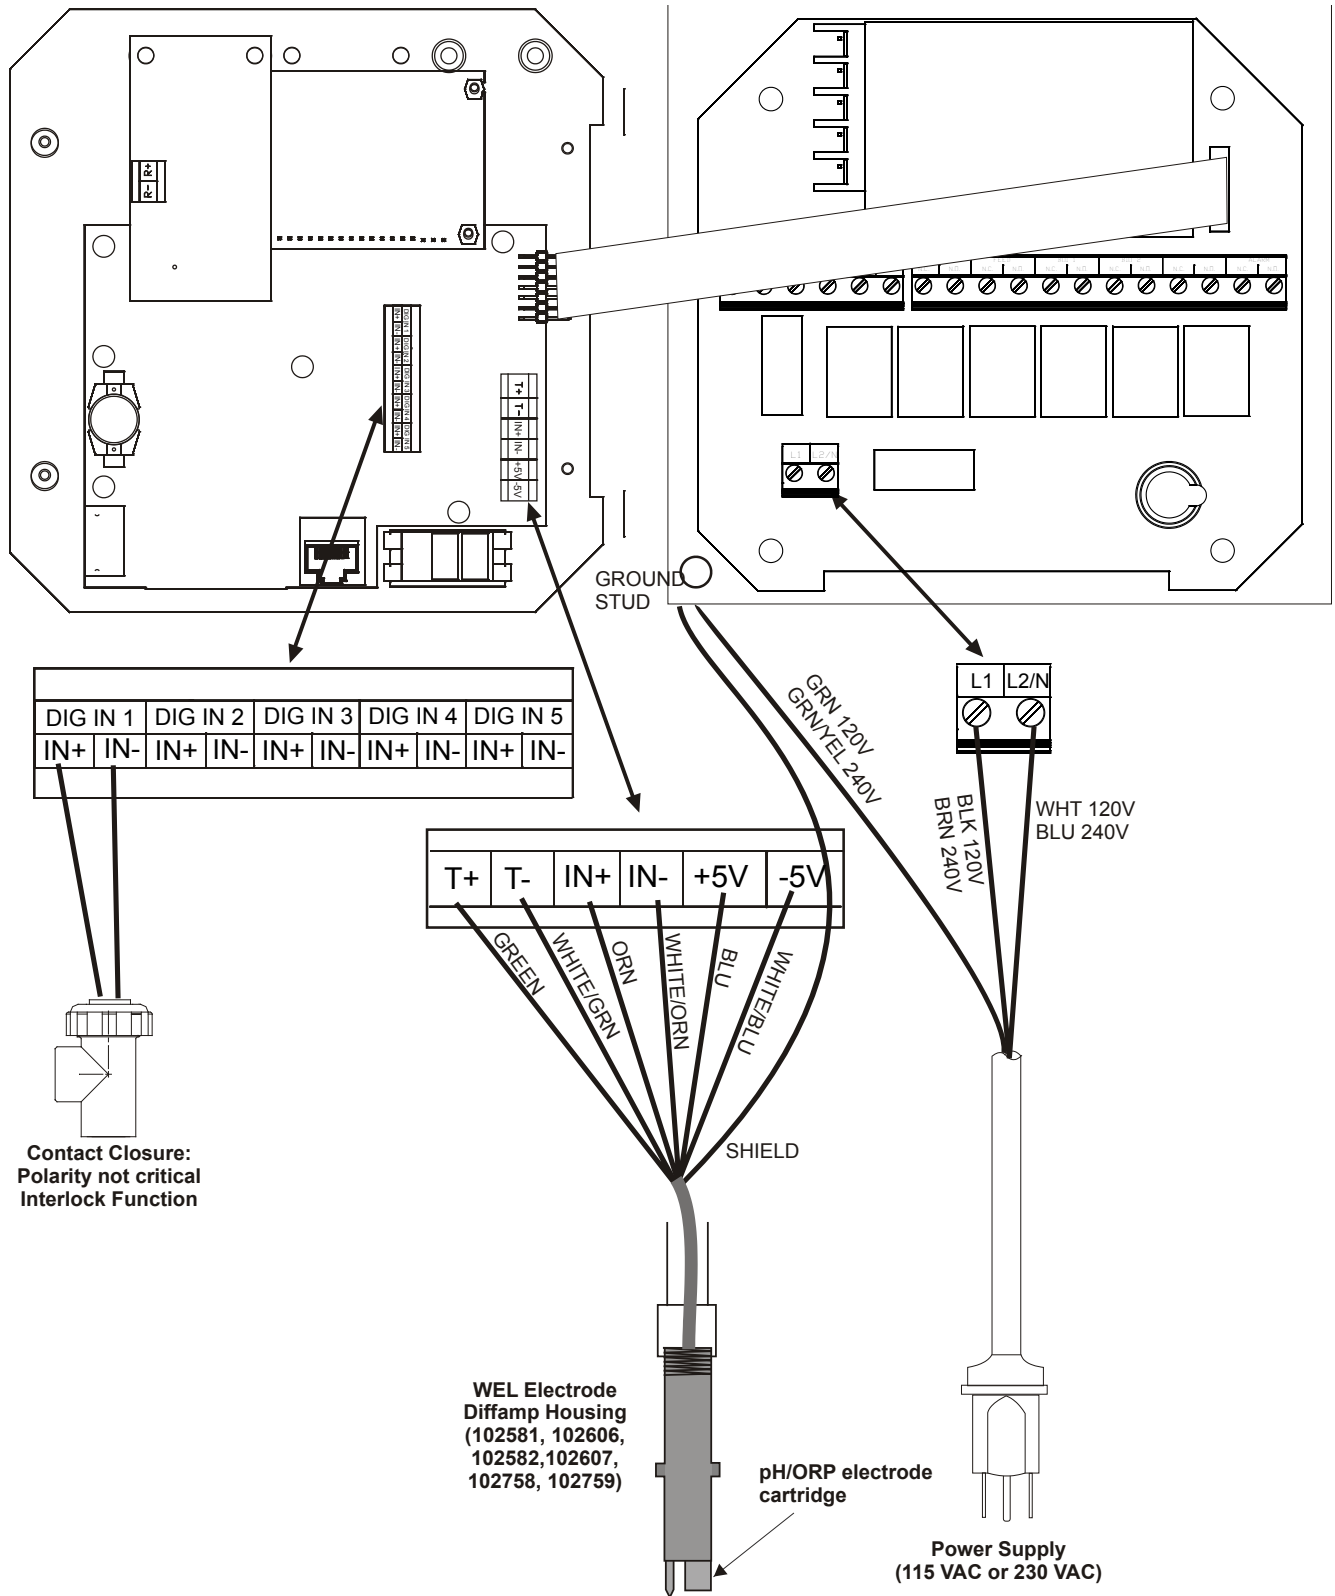




Figure 3a Wiring to WEL pH/ORP Electrode Housing

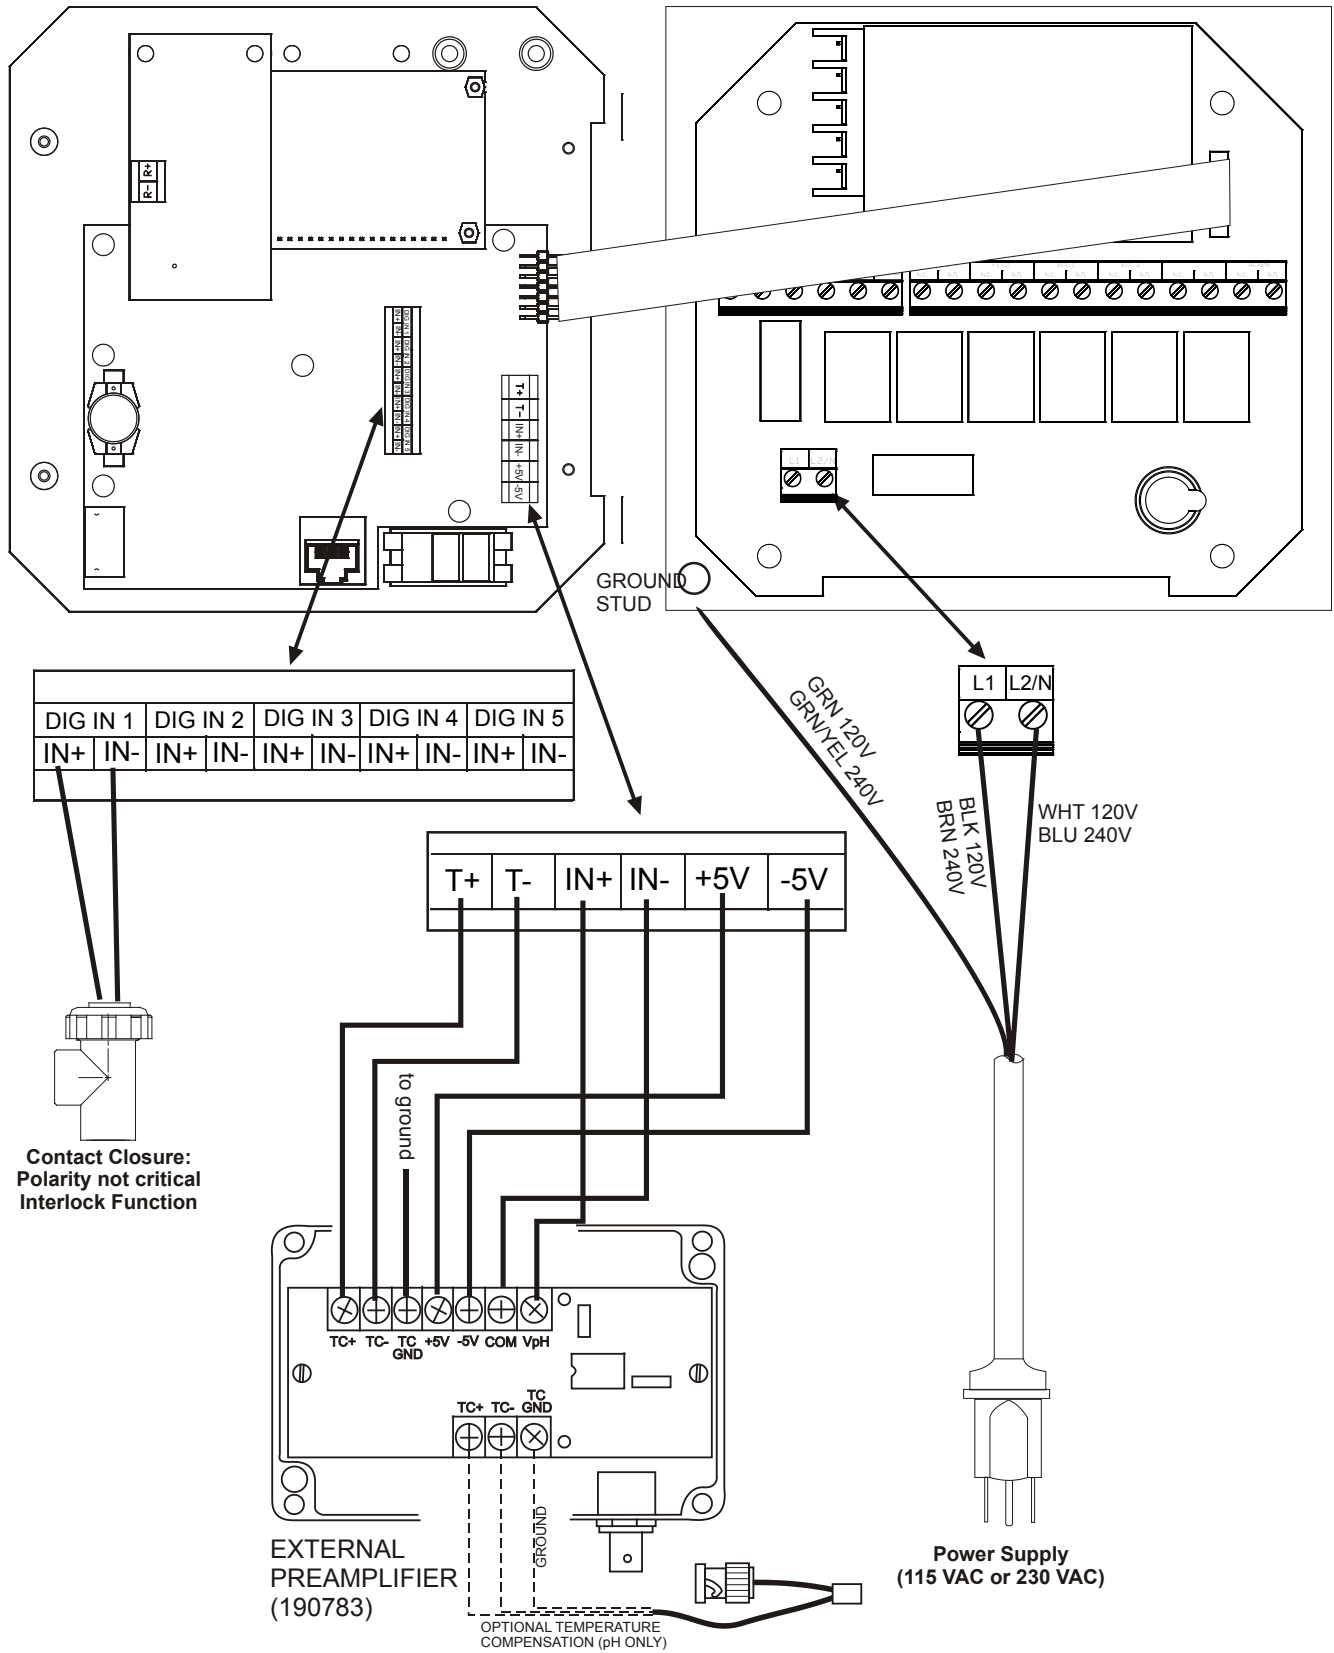

**Figure 3b Wiring a pH/ORP Electrode & External Pre-amplifier**

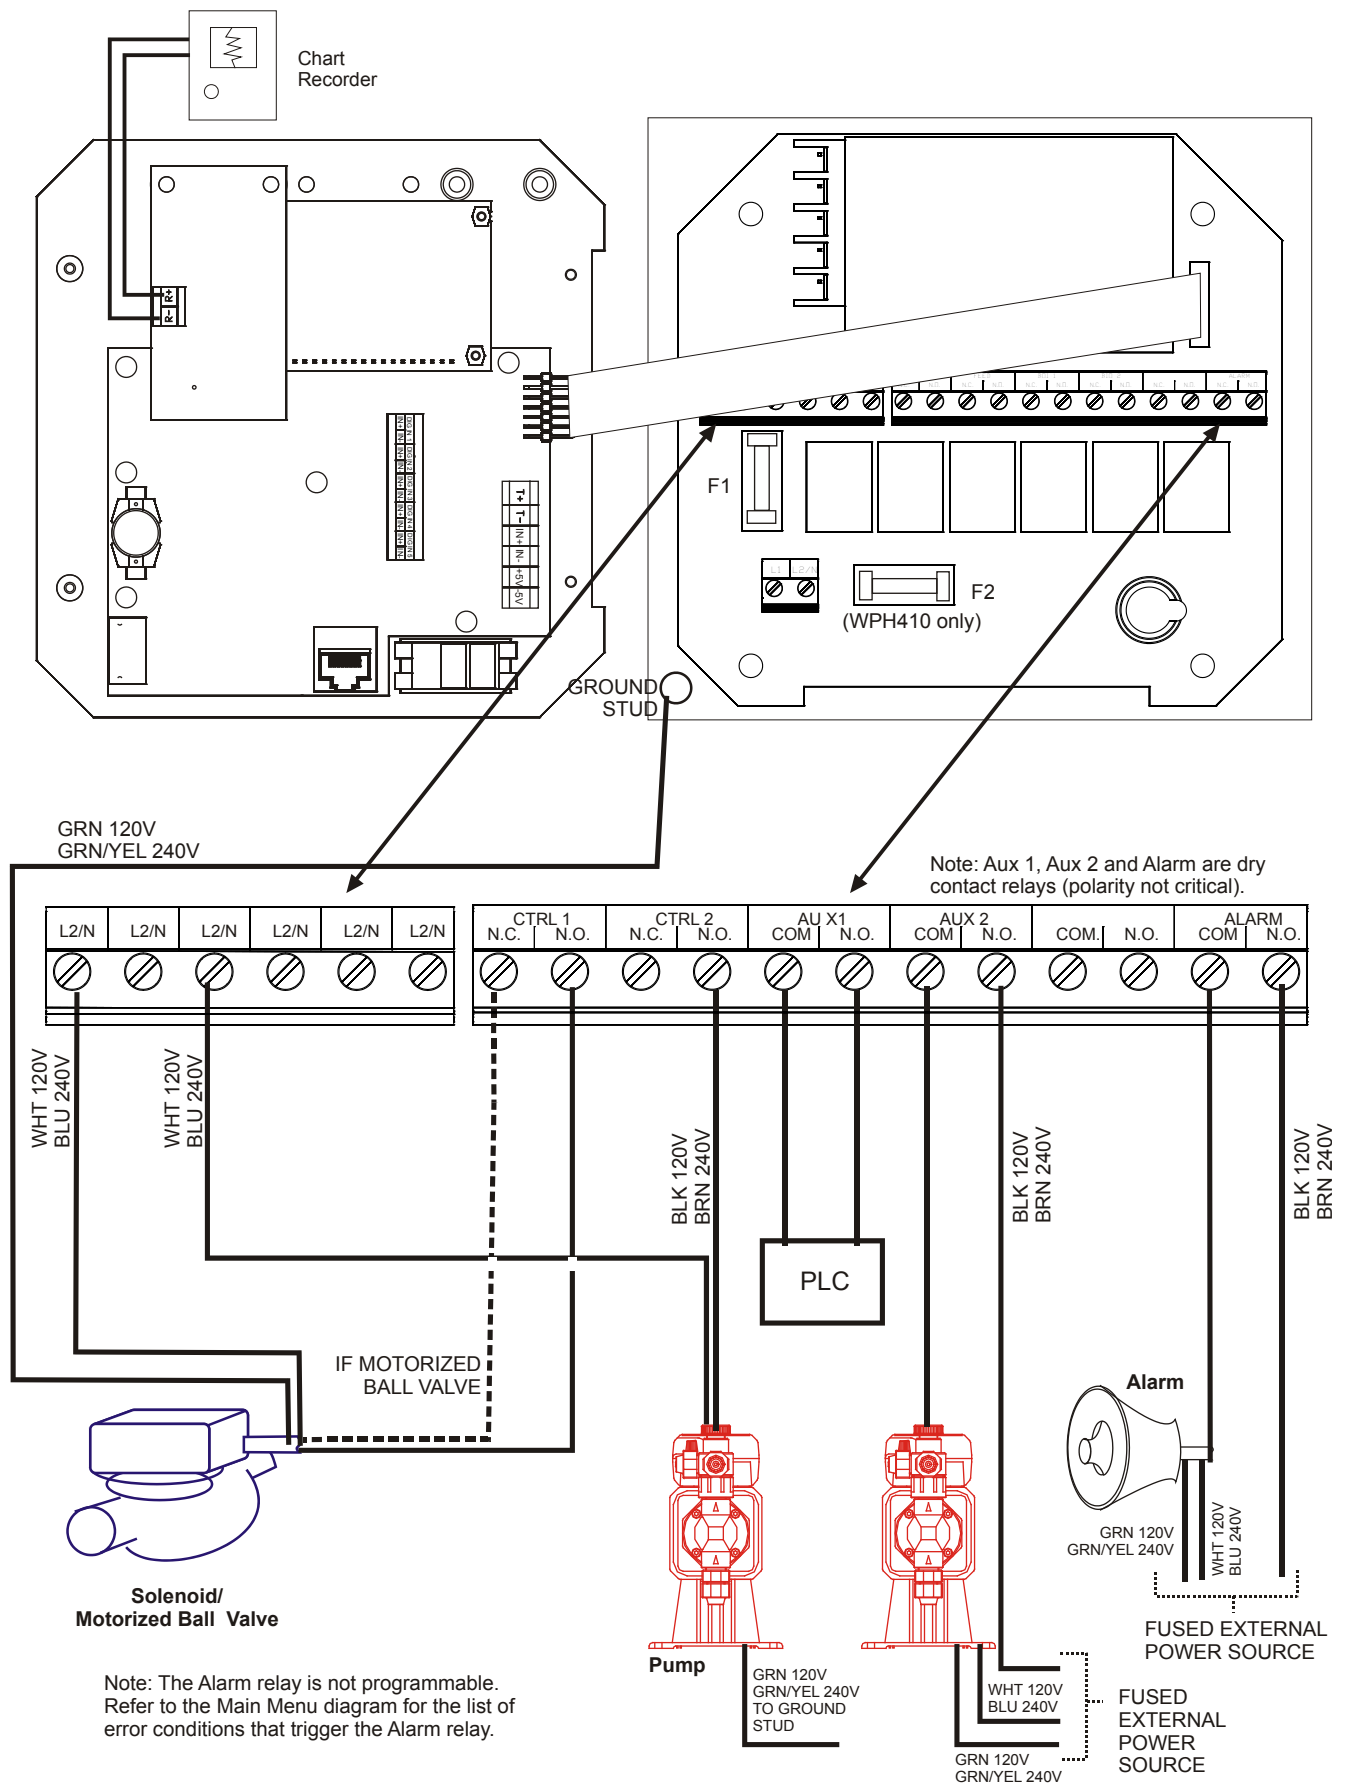


**Figure 4a WPH410 Outputs**

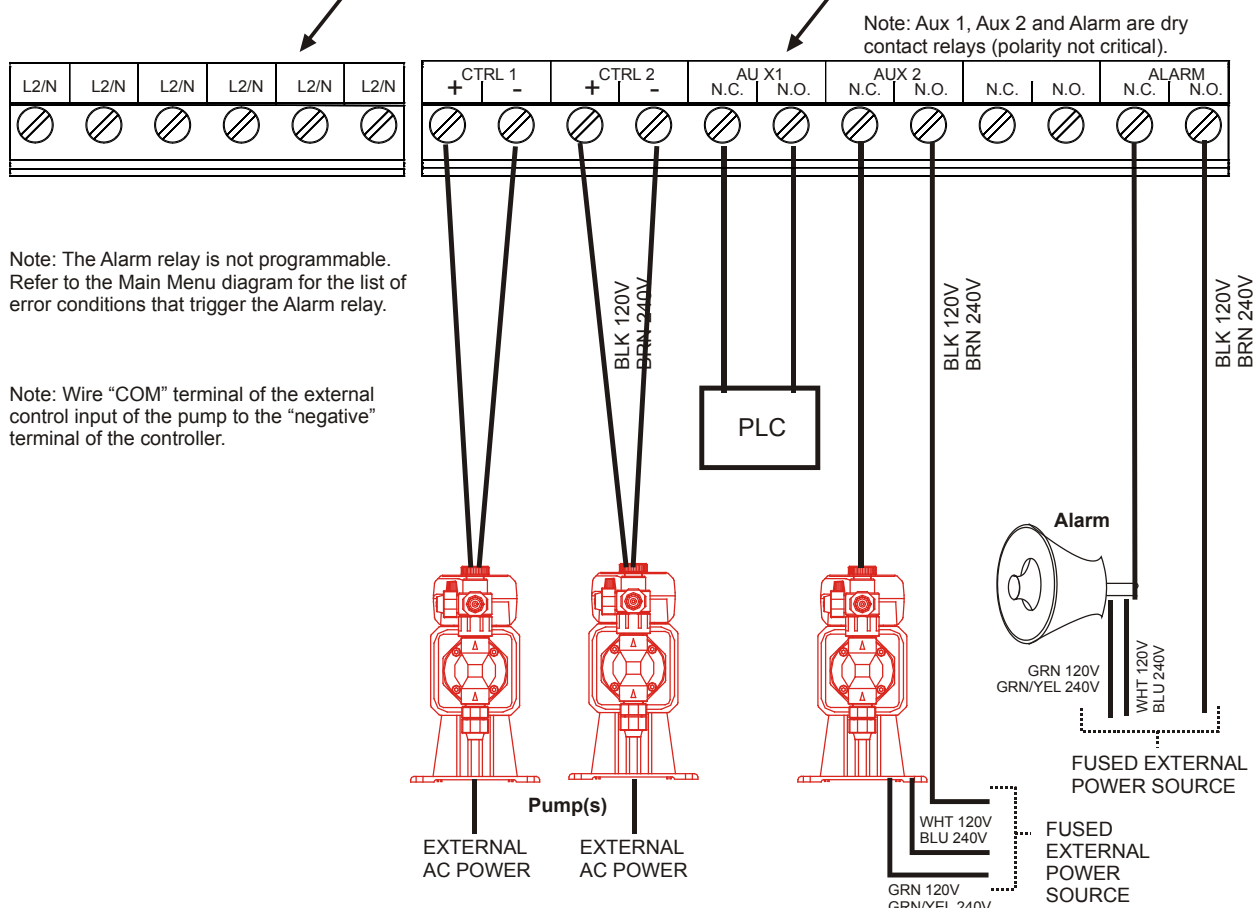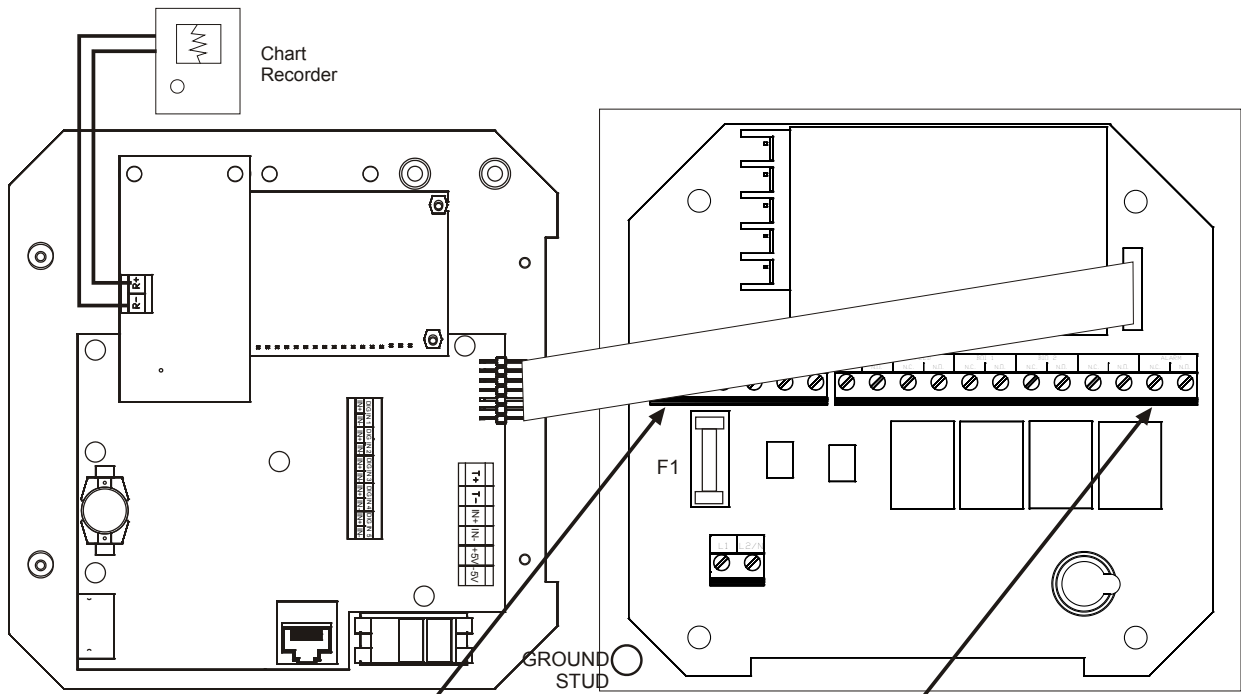

**Figure 4b WPH420 Outputs**

## 4.0 FUNCTION OVERVIEW

### 4.1 Front Panel

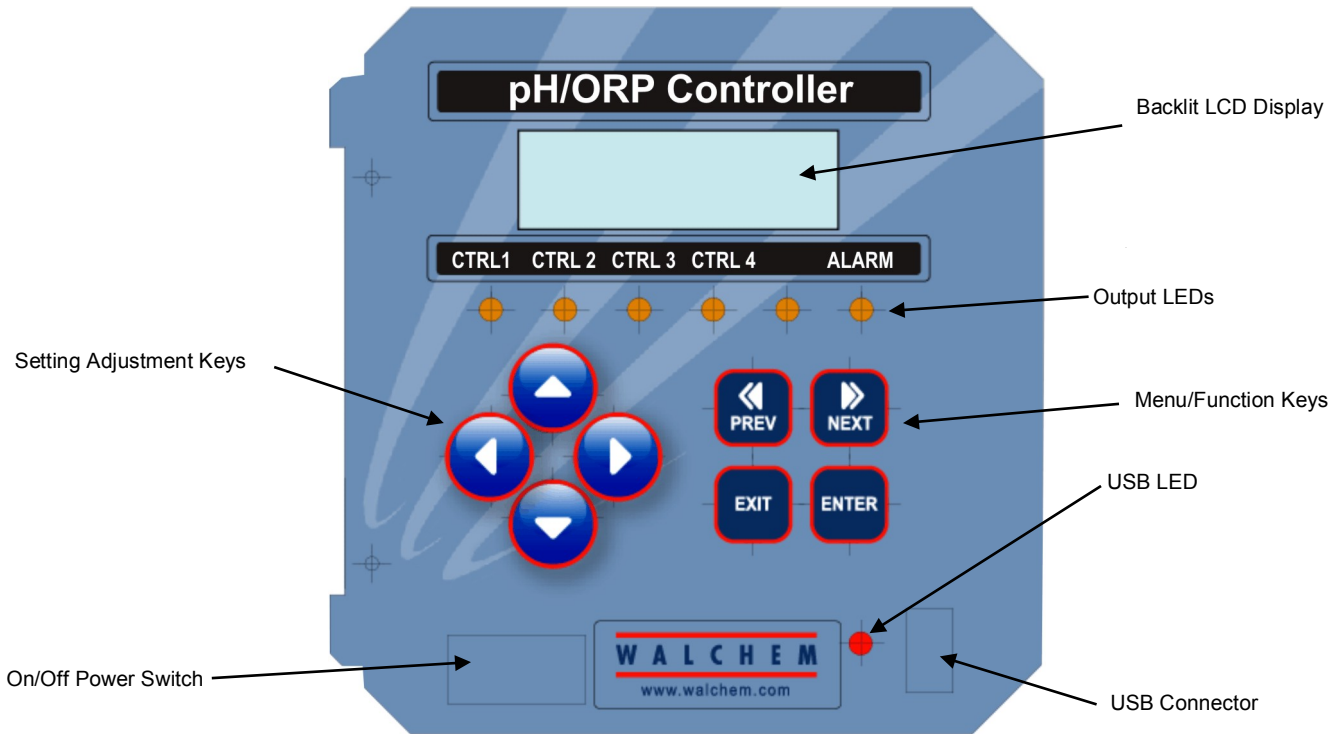

**Figure 5 Front Panel**

### 4.2 Display

A summary screen is displayed while the WPH controller is on. This display shows a bar graph of the pH/ORP process value relative to the set point, a digital display of the pH/ORP process value, and the current operating conditions.

Towards the center of the bar graph are the (S)'s, which represent the set points. The bar graph grows from the left hand side, and the point furthest to the right indicates where the process value is relative to the set points.


The bottom line of the summary screen displays the following potential status messages: Probe Error, Temp Sensor Err, Calibration Time, Output Timeout, High/Low Alarm, Range Alarm, In Range Output, Output1 On, Output2 On, Probe Wash, Probe Wash Hold, Normal and Interlock



**Figure 6 Summary Screen**

### 4.3 Keypad

The keypad consists of 4 directional arrow keys and 4 function keys. The arrows are used to move the adjustment cursor and change settings, while the function keys are used to enter values, and navigate the various menu screens. The function keys are **ENTER**, **EXIT**, **NEXT**, and **PREV** (previous). **NEXT** and **PREV** scroll through the various menu choices. **ENTER** is used to enter a submenu and to enter a value. **EXIT** is used to back up one menu level. If you are at the main menu level, **EXIT** will return you to the Summary Display.

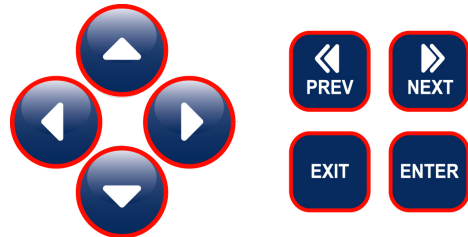

To change a value in a submenu, the left/right arrow keys move the cursor left and right to each digit or option that can be changed. The up/down arrows will change numeric values up or down, or scroll through option choices. Press **ENTER** only when you have finished making all of the changes for that menu screen.

### 4.4 Access Code

The WPH series controller is shipped with the access code disabled. If you wish to enable it, see Section 5.9 for operation. With the access code enabled, any user can view parameter settings, but not change them. Note that this provides protection only against casual tampering. Use a lock on the cover latch if you need more protection.

### 4.5 Startup

#### *Initial Startup*

After having mounted the enclosure and wired the unit, the controller is ready to be started.

Plug in the controller and turn on the power switch to supply power to the unit. The display will briefly show the WPH model number and then revert to the normal summary display. Scroll through the menus and calibrate the pH/ORP reading, optional temperature, and set the control parameters detailed in Section 5, Operation.

To return to the summary display, press the **EXIT** key until you return to this screen. The controller will automatically return to this screen after 10 minutes.

#### *Normal Startup*

Startup is a simple process once your set points are in memory. Simply check your supply of chemicals, turn on the controller, calibrate it if necessary and it will start controlling.

### 4.6 Shut Down

To shut the WPH controller down, simply turn off the power. Programming remains in memory.

The electrode must be stored with the measuring surfaces wet. If an extended shutdown will result in the electrode dehydrating, it must be removed from its position in the process and stored in pH 4 buffer solution.



## 5.0 OPERATION

---

These units control continuously while power is applied. Programming is accomplished via the local keypad and display.

To view the top level menu, press any key. The menu structure is grouped by inputs and outputs. Each input has its own menu for calibration and unit selection as needed. Each output has its own setup menu including set points, timer values, direction of control, etc. as needed. After ten minutes of inactivity in the menu, the display will return to the summary display. Keep in mind that even while browsing through menus, the unit is still controlling.

### 5.1 Main Menu

The exact configuration of your WPH controller determines which menus are available as you scroll through the settings. Certain menus are only available if you purchase certain options. All settings are grouped under the following main menu items.

Sensor	
Temperature	
Control 1	
Control 2	
Auxiliary 1	
Auxiliary 2	
Time	
4-20mA	Only if 4-20mA option installed
Access Code	
Datalog	Only if advanced USB feature is in model code
Config	Only if advanced USB feature is in model code
Upgrade	


The **NEXT** key travels forward through this list while the **PREV** key travels backwards through the list. Pressing **ENTER** will Enter the lower level menu that is currently displayed.

Possible Status Screens

- \* Probe Error
- \* Temp Sensor Err
- Probe Wash
- Probe Wash Hold
- \* Interlock
- \* Output Timeout
- \* Calibration Time
- Range Alarm
- In Range Output
- High/Low Alarm
- Output 1 On
- Output 2 On
- Normal

\* These status screens indicate that the diagnostic alarm relay is activated.

# Main Menu

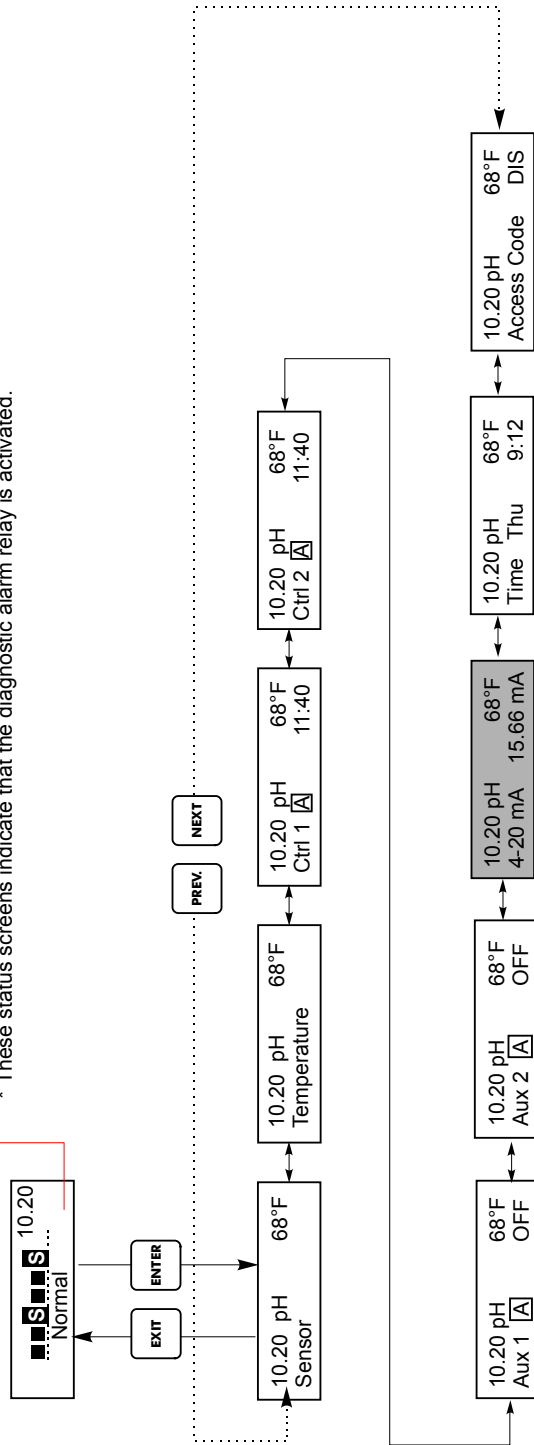

## Operation

- Press Enter key to enter menu or submenu.
- Press Exit key to exit menu.
- After 10 minutes of inactivity the controller will automatically return to the summary screen.

## Legend

- 4-20mA menu is only present if 4-20mA option is installed.

Figure 7 Main Menu

## 5.2 Sensor Menu

The sensor menu provides the following settings: Calibration history (informational only), 2 point calibration, 1 point calibration, pH/ORP selection, and other calibration menus. Each is discussed in detail below. Refer to the Sensor Menu chart on the next page.

**Note:** If you are programming the unit for the first time, press the **PREV** key once, and set the "Sensor Type" menu first to choose standard pH, antimony pH, or ORP. Then press **PREV** three times to get to the "Use Buffer Rec" menu and choose whether you want to use automatic buffer recognition or not. Then press **ENTER**.

<b>Cal'd</b>	Displays the date of the last electrode calibration.
<b>2 Pt Calibration</b>	Press the <b>ENTER</b> key to perform a 2 point calibration of the electrode. Note: 2 point calibration instructions are given in the following order: pH electrodes, using Auto Buffer Recognition, pH electrodes, not using Auto Buffer Recognition, ORP electrodes (Auto Buffer Recognition not available)
<b>2 Pt Calibration for pH electrodes, using Auto Buffer Recognition</b>	If using manual temperature compensation, the first display will be:
	<b>Cal Temp °F/C 68</b> Use the arrow keys to enter the actual temperature of the buffer solutions. If using automatic temperature compensation, this display will not appear. Press <b>ENTER</b> to continue.
	<b>Rinse Electrode</b> Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.
	<b>First Buffer</b> This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.
	<b>1st Buffer 7.00</b> The top line will show the temperature and the mV output from the electrode. The bottom line will read "1st Buffer" on the left hand side and either "??.??" or a pH value on the right hand side. If it reads a pH value, that means that it has recognized the buffer solution. Once the buffer value is recognized, it will stop flashing and the mV value will begin flashing. Once this has stabilized, it will stop flashing and go on to the next step. If it reads "??.??", that means it hasn't recognized the buffer solution because the mV output of the electrode is too far away from a standard buffer solution's theoretical mV value. If it can't recognize the buffer solution, the controller will beep and display "Unknown Buffer", and then display its best guess. Press <b>ENTER</b> to accept that guess, or change the value to the correct one using the arrow keys. If you press <b>ENTER</b> when it reads "??.??", the display will switch to "Buffer Override" and allow you to manually enter the buffer value.
	<b>Rinse Electrode</b> Remove the electrode from the first buffer solution and rinse it off with water. Press <b>ENTER</b> to continue.
	<b>Second Buffer</b> Place the electrode in the second buffer solution. The controller automatically advances.
	<b>2nd Buffer 4.00</b> The top line will display the temperature and mV readings, which will blink until they become stable. The bottom line will say "2nd Buffer" on the left hand side, either display the pH of the buffer solution or "??.??" on the right hand side and will go to the next step or display "Unknown Buffer" as in 1st Buffer above.
	<b>Cal Successful/Cal Failed</b> If the electrode response is good, then the display will read "Cal Successful". If the mV output of the electrode did not change enough between the two buffer solutions, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned, or replaced. It will also display the % difference from the theoretical slope. A failure occurs if the slope is more than 80% different than theoretical. See Troubleshooting Section for "Probe Error" if calibration failed.

	<p><b>Continue Y</b></p> <p>The controller will hold this display until you have replaced the electrode in the process, and press <b>ENTER</b>. Control will not begin until <b>ENTER</b> is pressed, or 10 minutes go by. If calibration failed, control will begin using old calibration setpoints.</p>
<p><b>2 Pt Calibration for pH electrodes, not using Auto Buffer Recognition</b></p>	<p>If using manual temperature compensation, the first display will be:</p>
	<p><b>Cal Temp °F/C 68</b></p> <p>Use the arrow keys to enter the actual temperature of the buffer solutions. If using automatic temperature compensation, this display will not appear. Press <b>ENTER</b> to continue.</p>
	<p><b>Rinse Electrode</b></p> <p>Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.</p>
	<p><b>First Buffer</b></p> <p>This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.</p>
	<p><b>1st Buffer 7.00</b></p> <p>The bottom line will display "1st Buffer" on the left hand side and "7.00" on the right hand side. Use the arrow keys to set the pH value of the 1st buffer, then press <b>ENTER</b>. The top line will now show the temperature and the mV input from the electrode. The mV will blink until the value is stable. The controller will automatically go onto the next step or you may press <b>ENTER</b> to go to the next step.</p>
	<p><b>Rinse Electrode</b></p> <p>Remove the electrode from the buffer and rinse it off. Press <b>ENTER</b> to go to the next step.</p>
	<p><b>Second Buffer</b></p> <p>This is a prompt to place the electrode in the second buffer. Again, in a few seconds the controller will automatically go to the next step.</p>
	<p><b>2nd Buffer 4.00</b></p> <p>The bottom line will display "2nd Buffer" on the left hand side and "4.00" on the right hand side. Use the arrow keys to set the pH value of the 2nd buffer, then press <b>ENTER</b>. The top line will now show the temperature and the mV input from the electrode. The mV will blink until the value is stable. The controller will automatically go onto the next step or you may press <b>ENTER</b> to go to the next step.</p> <p>The controller will go on to the next step once the mV signal is stable.</p>
	<p><b>Cal Successful/Cal Failed</b></p> <p>If the electrode response is good, then the display will read "Cal Successful". If the mV output of the electrode did not change enough between the two buffer solutions, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned, or replaced. It will also display the % difference from theoretical slope. A failure occurs if the slope is more than 80% different than theoretical.</p>
	<p><b>Continue Y</b></p> <p>The controller will hold this display until you replace the electrode in the process and press <b>ENTER</b>. Control will not begin until <b>ENTER</b> is pressed or 10 minutes go by.</p>
<p><b>2 Pt Calibration for ORP electrodes (no Auto Buffer Recognition available)</b></p>	<p><b>Rinse Electrode</b></p> <p>Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.</p>
	<p><b>First Buffer</b></p> <p>This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.</p>
	<p><b>Input XX mV</b></p> <p>The display will show the mV reading from the electrode. The entire number will blink until the reading is stable, then the display will change to:</p>
	<p><b>Buffer XX</b></p> <p>Now you can change the mV value of the buffer, by using the arrow keys and pressing <b>ENTER</b>.</p>
	<p><b>Rinse Electrode</b></p> <p>Remove the electrode from the buffer and rinse it off. Press <b>ENTER</b> to go to the next step.</p>

	<p><b>Second Buffer</b></p> <p>This is a prompt to place the electrode in the second buffer. Again, in a few seconds the controller will automatically go to the next step.</p> <hr/> <p><b>Input XXX mV</b></p> <p>The display will show the mV reading from the electrode. The entire number will blink until the reading is stable, then the display will change to:</p> <hr/> <p><b>Buffer XXX</b></p> <p>Now you can change the mV value of the buffer, by using the arrow keys and pressing <b>ENTER</b>.</p> <hr/> <p><b>Cal Successful/Cal Failed</b></p> <p>If the electrode response is good, then the display will read "Cal Successful". If the mV output of the electrode did not change enough between the two buffer solutions, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned, or replaced.</p> <hr/> <p><b>Continue Y</b></p> <p>The controller will hold this display until you replace the electrode in the process and press <b>ENTER</b>. Control will not begin until <b>ENTER</b> is pressed or 10 minutes go by.</p>
<p><b>1 Pt Calibration</b></p>	<p>Press <b>ENTER</b> to perform a 1 point calibration of the electrode.  Note: 1 point calibration instructions are given in the following order:  pH electrodes, using Auto Buffer Recognition  pH electrodes, not using Auto Buffer Recognition  ORP electrodes (Auto Buffer Recognition not available)</p>
<p><b>1 Pt Calibration for pH Electrodes, using Auto Buffer Recognition</b></p>	<p>If using manual temperature compensation, the first display will be:</p> <hr/> <p><b>Cal Temp °F/C 68</b></p> <p>Use the arrow keys to enter the actual temperature of the buffer solutions. If using automatic temperature compensation, this display will not appear.</p> <hr/> <p><b>Rinse Electrode</b></p> <p>Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.</p> <hr/> <p><b>First Buffer</b></p> <p>This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.</p> <hr/> <p><b>1st Buffer 4.00</b></p> <p>The top line will show the temperature and the mV output from the electrode. These values will blink until they become stable.</p> <p>The bottom line will read "1st Buffer" on the left hand side and either "??.???" or a pH value on the right hand side. If it reads a pH value, that means that it has recognized the buffer solution. The controller will then go on to the next step.</p> <p>If it reads "??.???", that means it hasn't recognized the buffer solution because the mV output of the electrode is too far away from a standard buffer solution's theoretical mV value. If it can't recognize the buffer solution, the controller will beep and display "Unknown Buffer", and then display its best guess. Press <b>ENTER</b> to accept that guess, or change the value to the correct one using the arrow keys.</p> <p>If you press <b>ENTER</b> when it reads "??.???", the display will switch to "Buffer Override" and allow you to manually enter the buffer value.</p> <hr/> <p><b>Cal Successful/Cal Failed</b></p> <p>If the electrode response is good, then the display will read "Cal Successful". If the controller can not calculate an acceptable slope from that mV reading, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned or replaced.</p> <hr/> <p><b>Continue Y</b></p> <p>The controller will hold this display until you replace the electrode in the process and press <b>ENTER</b>. Control will not begin until <b>ENTER</b> is pressed or 10 minutes go by.</p>

<b>1 Pt Calibration for pH electrodes, not using Auto Buffer Recognition</b>	If using manual temperature compensation, the first display will be:
	<b>Cal Temp °F/C 68</b> Use the arrow keys to enter the actual temperature of the buffer solutions. Press <b>ENTER</b> to go on to the next step. If using automatic temperature compensation, this display will not appear.
	<b>Rinse Electrode</b> Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.
	<b>First Buffer</b> This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.
	<b>Buffer 4.00</b> Use the arrow keys to change the value of the buffer being used, then press <b>ENTER</b> .
	<b>1st Buffer 4.00</b> The bottom line will display "1st Buffer" on the left hand side and "4.00" on the right hand side. Use the arrow keys to set the pH value of the 1st buffer, then press <b>ENTER</b> . The top line will now show the temperature and the mV input from the electrode. The mV will blink until the value is stable. The controller will automatically go onto the next step or you may press <b>ENTER</b> to go to the next step.
	<b>Cal Successful/Cal Failed</b> If the electrode response is good, then the display will read "Cal Successful". If the controller can not calculate an acceptable slope from that mV reading, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned or replaced.
	<b>Continue Y</b> The controller will hold this display until you replace the electrode in the process and press <b>ENTER</b> . Control will not begin until <b>ENTER</b> is pressed or 10 minutes go by.
<b>1 Pt Calibration for ORP electrodes (no Auto Buffer Recognition available)</b>	<b>Rinse Electrode</b> Remove the electrode from the process and rinse it off. Press <b>ENTER</b> to go to the next step.
	<b>First Buffer</b> This is a prompt to place the electrode in the first buffer. In a few seconds the controller will automatically go to the next step.
	<b>Input 96 mV</b> The display will show the mV reading from the electrode. The entire number will blink until the reading is stable, then the display will change to:
	<b>Buffer 96</b> Now you can change the mV value displayed to the known value of the buffer, by using the arrow keys and pressing <b>ENTER</b> .
	<b>Cal Successful/Cal Failed</b> If the electrode response is good, then the display will read "Cal Successful". If the controller can not calculate an acceptable slope from that mV reading, it will read "Cal Failed". A failure usually means that the electrode needs to be cleaned or replaced.
	<b>Continue Y.</b> The controller will hold this display until you replace the electrode in the process and press <b>ENTER</b> . Control will not begin until <b>ENTER</b> is pressed or 10 minutes go by.
<b>Days Btwn Cal</b>	Use the arrow keys to set the number of days that you would like to go by before recalibrating the electrode. The controller will prompt you to recalibrate when that time has expired. Setting the number of days to zero will disable this feature.
<b>Use Buffer Rec</b>	Use the Up and Down arrows to toggle between Y (yes) and N (no). If you choose to use automatic buffer recognition, then the controller will recognize which buffer solution the electrode has been placed in. If you choose not to, then you will have to enter the information manually during the 1 or 2 point calibration procedures. Press <b>ENTER</b> to accept the choice displayed.
<b>Buffer Set</b>	This menu will only appear if you have decided to use automatic buffer recognition. Press <b>ENTER</b> to change the type of buffers that will be used. Use the Up and Down arrows to toggle between US buffers (pH 4, 7 and 10) or DIN standard buffers (pH 6.75, 9.23, etc.) then press <b>ENTER</b> to make your selection.

<b>Input</b>	This menu displays the mV from the electrode. It is useful for troubleshooting.
<b>Self Test</b>	Press <b>ENTER</b> to perform a self-test. If it says "FAIL" in the upper right hand corner, this indicates a problem with the controller which should be returned for repair. If it passes, and you have a problem calibrating, it is an electrode or preamp problem.
<b>Sensor Type</b>	Press <b>ENTER</b> to set up the controller to match the type of electrode to be used. Use the Up and Down arrows to toggle between standard pH, antimony pH, and ORP, then press <b>ENTER</b> to make your selection. The controller will warn you to check your set points because the units of measure have changed. Press any key to clear the warning messages.

# Sensor Menu

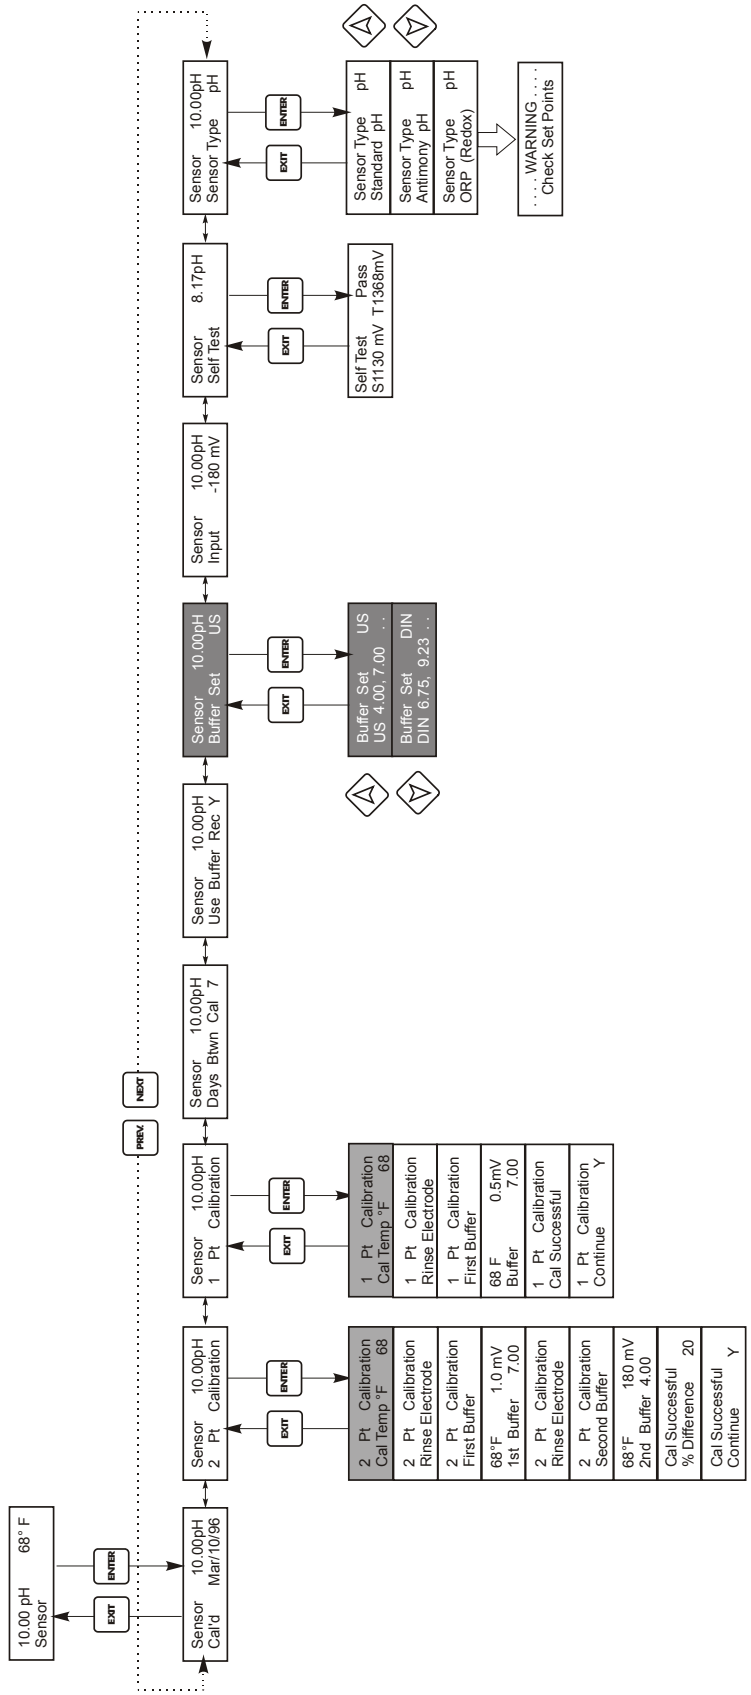


Figure 8 Sensor Menu

## Operation

Press Enter key to enter menu.  
 Press Exit key to exit menu.  
 Blinking fields may be edited with the adjust arrows.  
 Press Enter when modification is complete to return to Main Menu Level.

## Legend


Menu choices that appear when Buffer Recognition is selected.  
 Menu choices that appear only when Auto Temperature Compensation is not recognized.



### 5.3 Temperature Menu (this menu does not appear if an ORP sensor has been selected)

The temperature menu contains the following settings: Calibrate and Units (if the Pt100 or Pt1000 sensor is detected when the unit is powered on) or Manual Temp and Units (if no Pt100 or Pt1000 sensor is detected at power-up). Refer to the Temperature Menu chart below.

<b>Calibrate</b>	To Calibrate the Temperature, use a thermometer to measure the fluid temperature and adjust the WPH controller to match. Once Calibrate is entered, the unit continuously displays temperature readings. Press the Up or Down arrow key to change the value displayed to match the thermometer. You must press ENTER to activate the new calibration. You must press the EXIT key to exit calibration.
<b>Man Temp</b>	This menu appears only if no temperature element is connected at power-up. Use the arrow keys to adjust the temperature displayed to match that of the water.
<b>Units</b>	You may choose to display temperature in °C or °F. Press ENTER and the Up or Down Arrow keys to change the temperature units for display.

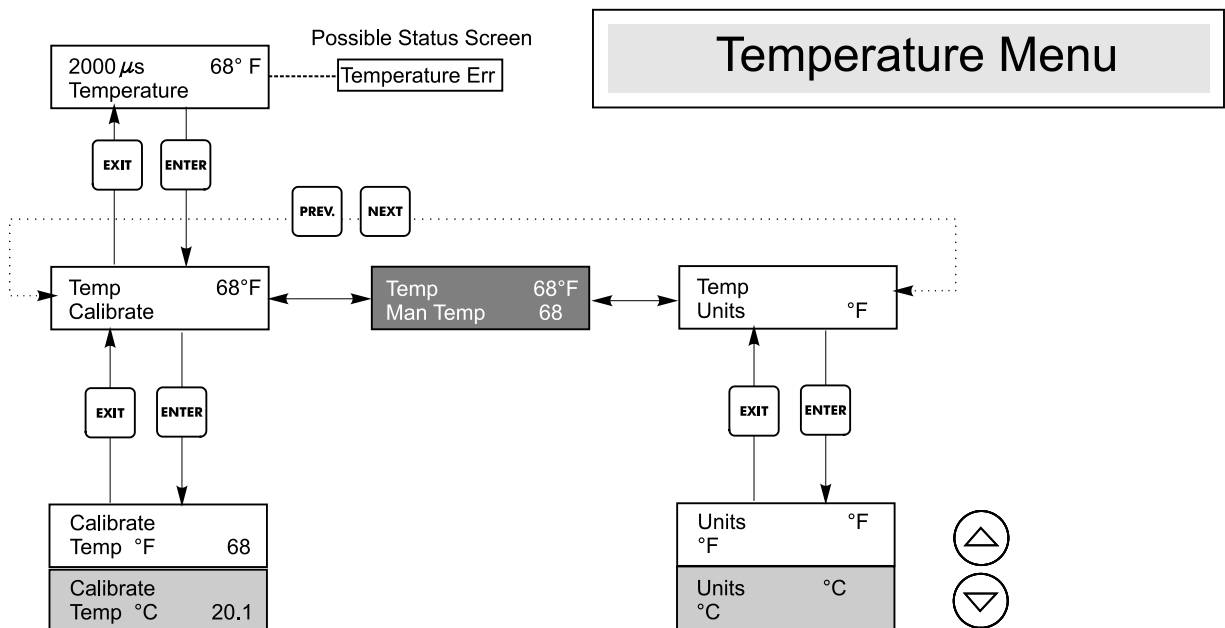

### Legend


- Menu wording that appears when °C units are selected.
- Menu wording that appears when Automatic Temperature Compensation is selected.
- Menu wording that appears when Manual Temperature Compensation is selected.


**Figure 9 Temperature Menu**

## 5.4 Control 1 and Control 2 Menus (FOR ON/OFF CONTROLLERS)

The Control 1 and Control 2 menus are separate from each other but operate in exactly the same way. Each menu provides the following independent settings: Set Point, Dead Band, Time Limit, Interlock, Control Direction, HOA, Set Point, Dead Band, and Time Limit. The Control menu will be indicated on the display by one of the following: (The 'A' indicates that the output is being controlled automatically.)

Ctrl 1 A	<b>OFF</b>	Indicates that the output is currently OFF.
Ctrl 1 A	<b>10:00</b>	Indicates the length of time that the output has been ON.
Ctrl 1 A	<b>Intrck</b>	Indicates that control has been suspended because the Interlock switch is Open
Ctrl 1 A	<b>TIMEOUT</b>	Indicates that the output has been on longer than the Time Limit.
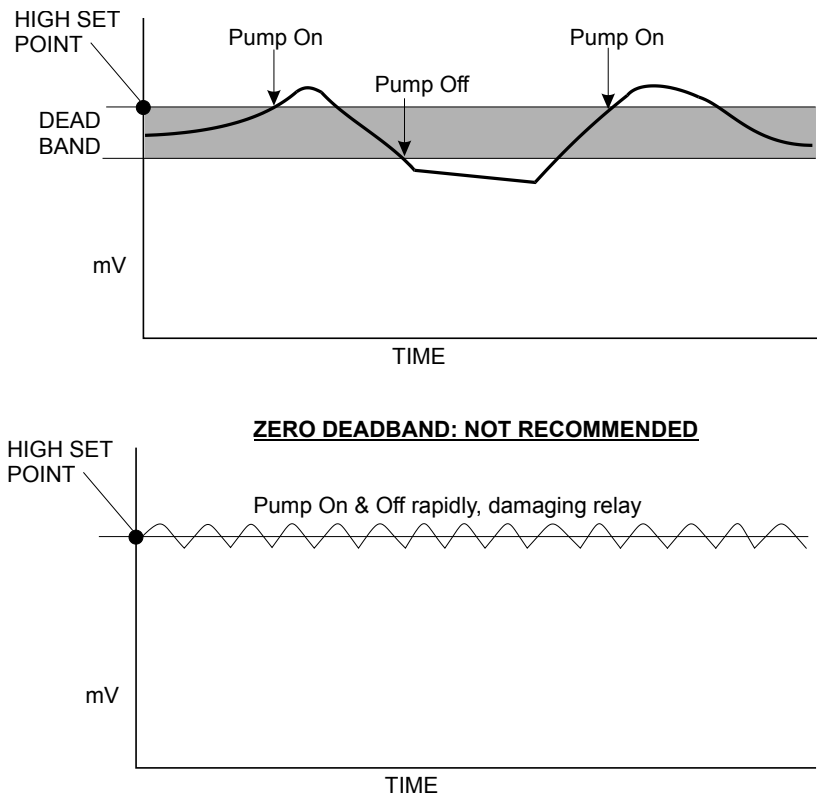
<b>Hi/Lo Set Point</b>	Use the arrow keys to adjust the display to read the desired set point value. Press <b>ENTER</b> to accept the change.
<b>Dead Band</b>	<p>Use the arrow keys to set the desired dead band, then press <b>ENTER</b>. If the set point is pH 7.00, and the dead band is 0.05 pH units, then the relay will close at pH 7.00 and open 0.05 pH units away from 7.00.</p>  <p><b>ZERO DEADBAND: NOT RECOMMENDED</b></p>
<b>Time Limit</b>	Use the arrow keys to set the time limit in min:sec for the output to be active, then press <b>ENTER</b> . If it is set for "0:00", no limit will be imposed, and the output could stay on forever.
<b>Interlock</b>	Use the Up and Down arrows to toggle between Y(Yes) and N(No). Choosing Y means that the output will deactivate if the device attached to the controller is open. For example, if the electrode is installed in a recirculating pipe line, a flow switch that is closed if flow is sufficient and open if flow is insufficient may be installed in the line, so that if flow past the electrode stops, the controller will not pump in chemicals based on a stagnant sample. Similarly, a level switch may be attached to prevent control of an empty batch tank.
<b>HOA</b>	Use the Left and Right arrows to move between Hand, Off and Auto. In Hand (Manual) mode, the output will be turned on immediately for a maximum of 10 minutes. In the Off mode, the output will be turned off indefinitely. In the Auto mode, the output turns on and off in response to changes in the process value relative to the set point. The letter inside the block on the status screen indicates which mode the output is in.

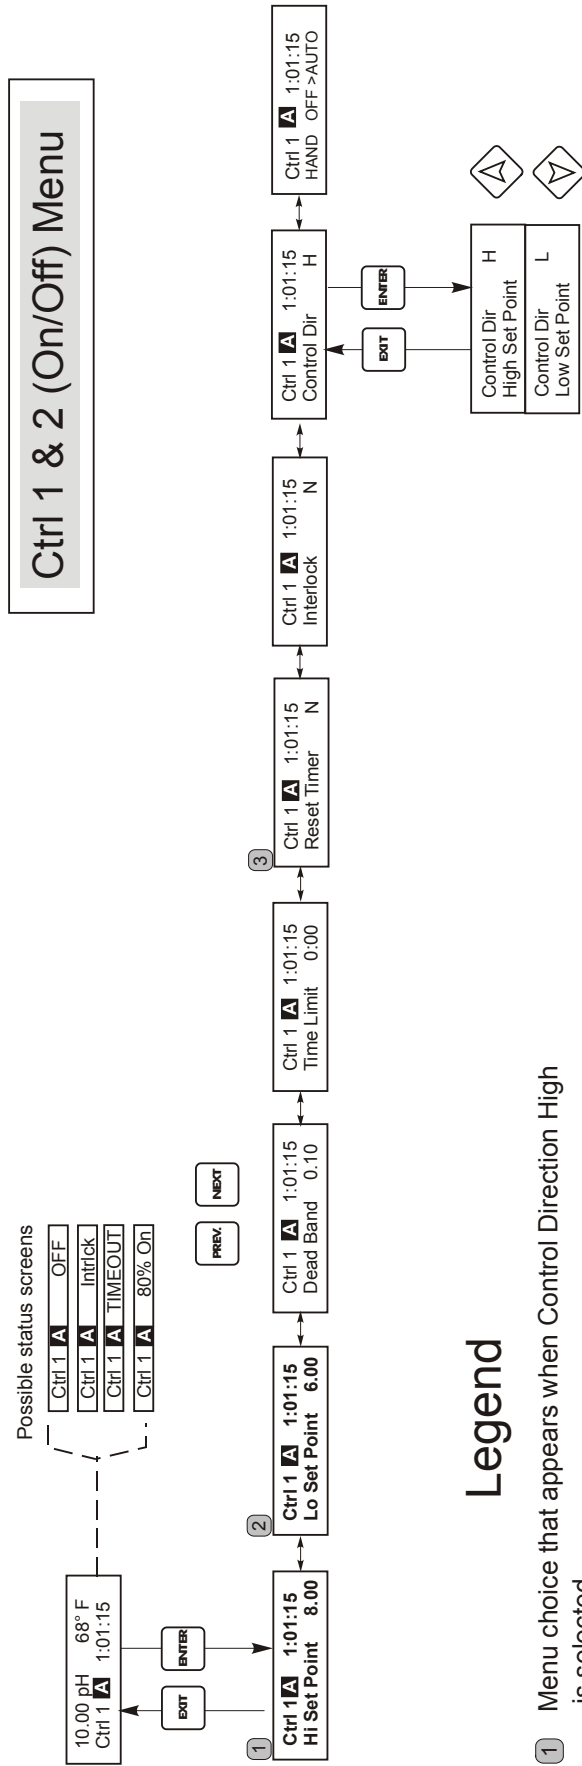

## Legend

- 1 Menu choice that appears when Control Direction High is selected.
- 2 Menu choice that appears when Control Direction Low is selected.
- 3 Only appears if time limit has expired.

## Operation

- Press Enter key to enter menu.
- Press Exit key to exit menu.
- Blinking fields may be edited with the adjust arrows.
- Press Enter when modification is complete to return to Main Menu Level.

Figure 10 Control 1 & 2 (On/Off) Menu


## 5.5 Control 1 and Control 2 Menu (FOR PROPORTIONAL CONTROLLERS)

The Control 1 and Control 2 menus are separate from each other but operate in exactly the same way. Each menu provides the following independent settings: Set Point, Prop Band, Control Direction, Min SPM Rate, Max SPM Rate, Time Limit, Interlock and HOA. The top level menu status line may display the following messages: Off, Intrlck, Timeout or SPM. "Off" indicates that the output is off.

Ctrl 1 A	<b>Intrlck</b>	Indicates that the output would be on but is not because of a signal from a flow switch or level switch is stopping control.
Ctrl 1 A	<b>Timeout</b>	Indicates that the output has been on for longer than the maximum time programmed by the user.
Ctrl 1 A	<b>SPM</b>	Shows the stroke rate of the pump

<b>Hi/LoSet Point</b>	Use the arrow keys to adjust the display to read the desired set point value. Press <b>ENTER</b> to accept the change.
<b>Prop Band</b>	<p>Use the arrow keys to adjust how far away from the set point the process value must get before the pump is stroking at the maximum rate. For example, if the lower set point is 6.00 pH, and the proportional band is 0.5, then the pump will stroke at its maximum rate when the pH is 0.5 units away from the set point (at pH 5.5).</p> <p>The following graph shows the effect of the various settings:</p> <p>If the controller overshoots the set point, make the prop band larger. If the controller can't keep up with the additions, make the prop band value smaller, or increase the Max SPM rate value, or source a pump with a higher flow output.</p>
<b>Control Dir</b>	Press <b>ENTER</b> to change the direction of control, then use the Up and Down arrows to toggle between High Set Point and Low Set Point, and press <b>ENTER</b> to make your choice. A high set point will turn on the relay when the process value goes over the set point value (to add an acid, or reducing agent, or as a high alarm). A low set point will turn on the relay when the process value goes below the set point value (to add an alkali, or oxidizer, or as a low alarm). The further away from the set point the process value gets, the faster the pump will stroke.
<b>Min SPM Rate</b>	Use the arrow keys to set the minimum stroke rate of the pump. If you want to stop when the set point has been reached, enter 0. If you need the pump to run at a certain rate regardless of the set point, enter that stroke rate. This may be useful in once-through control schemes.
<b>Max SPM Rate</b>	Use the arrow keys to enter the maximum stroke rate of the pump. This may be the maximum that the pump is capable of, or it may be less if the pump is oversized for your application, but it can NOT be higher than the pump is capable of, or the pump will not stroke at all.

<b>Time Limit</b>	Use the arrow keys to set the time limit in min:sec for the output to be active, then press <b>ENTER</b> . If it is set for "0:00", no limit will be imposed, and the output could stay on forever.
<b>Interlock</b>	Use the Up and Down arrows to toggle between Y(Yes) and N(No). Choosing Y means that the output will deactivate if the device attached to the controller is open. For example, if the electrode is installed in a recirculating pipe line, a flow switch that is closed if flow is sufficient and open if flow is insufficient may be installed in the line, so that if flow past the electrode stops, the controller will not pump in chemicals based on a stagnant sample. Similarly, a level switch may be attached to prevent control of an empty batch tank.
<b>HOA</b>	Use the Left and Right arrows to move between Hand, Off and Auto. In Hand (Manual) mode, the output will be turned on immediately at the maximum programmed rate for a maximum of 10 minutes. In the Off mode, the output will be turned off indefinitely. In the Auto mode, the output turns on and off in response to changes in the process value relative to the set point. The letter inside the block on the status screen indicates which mode the output is in.

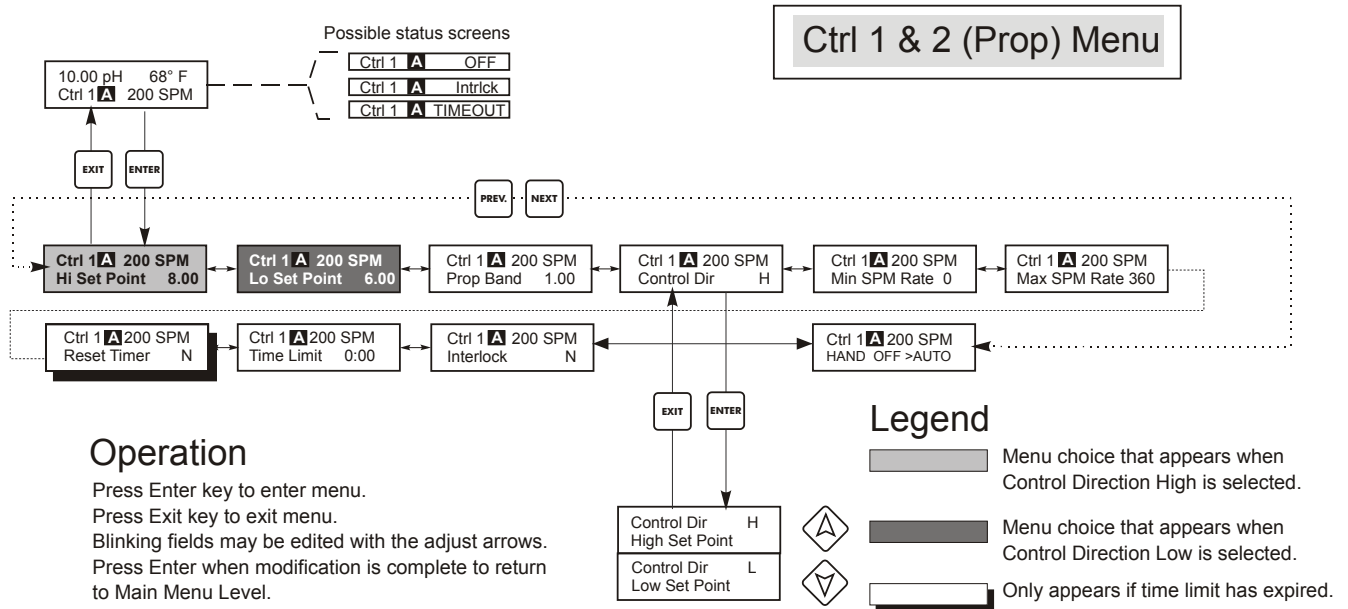

**Figure 11 Control 1 & 2 (Proportional) Menu**

## 5.6 Auxiliary 1 and 2 Menu

The Aux 1 and 2 relays may be configured to operate in a number of ways. They may be a low alarm, high alarm, an out-of-range alarm, an in-range output, or a probe wash.

The Aux 1 and 2 menus provides the following settings, which only appear if the appropriate output mode is selected: Low Alarm Pt, High Alarm Pt, Probe Wash Sched, Hold Time, Mode. Refer to the Auxiliary 1 and 2 Menu chart.

Note: When programming the controller for the first time, press **ENTER** to get into the submenus, then press **PREV** twice to get to the Output Mode menu.


Aux 1 A	<b>OFF</b>	Indicates that the output is currently OFF.
Aux 1 A	<b>10.00</b>	Indicates the length of time that the output has been ON.
Aux 1 A	<b>PW</b>	Indicates a probe wash cycle is in progress.

<b>Mode</b>	Press <b>ENTER</b> then use the Up and Down arrows to toggle between the various choices:
	<b>Low Alarm</b> Press <b>ENTER</b> if you want the Aux 1 relay to close if the process value goes below a certain value.
	<b>High Alarm</b> Press <b>ENTER</b> when this is displayed if you want the Aux 1 relay to close if the process value goes above a certain value.
	<b>Out Range Alarm</b> Press <b>ENTER</b> if you want the Aux 1 relay to close if the process value goes either above or below certain values.
	<b>In Range Output</b> Press <b>ENTER</b> if you want the Aux 1 relay to close if the process value is between two values. This is useful to open a solenoid valve if the pH/ORP has been corrected and you want to empty a batch tank.
	<b>Probe Wash</b> Press <b>ENTER</b> if you want to use the Aux 1 relay to interrupt control and activate a pump or valve to wash down the electrode.
<b>Lo Alarm Pt</b>	Only appears if either the low alarm or in/out range mode has been selected. Use the arrow keys to adjust the process value below which the relay will close. (In the in-range mode, it is the process value ABOVE which the relay will close).
<b>Hi Alarm Pt</b>	Only appears if either the high alarm or in/out range mode has been selected. Use the arrow keys to adjust the process value above which the relay will close. (In the in-range mode, it is the process value BELOW which the relay will close).
<b>Dead Band</b>	Use the arrow keys to set the desired dead band, then press <b>ENTER</b> .
<b>Probe Wash Sched</b>	Only appears if the probe wash mode has been selected. Press <b>ENTER</b> to program the probe wash schedule. The display may read "Event A 12:00 20" which indicates that the probe wash will start at noon and the pump will run for 20 seconds. Use the arrow keys to change the time of day or the pump on-time. The maximum wash time is 99 seconds. If the electrode needs to be cleaned more than once a day, additional events may be accessed by pressing <b>NEXT</b> . The time is Military time (1:00 PM = 13:00). Press <b>EXIT</b> to go back to the Aux 1 menu level
<b>Hold Time</b>	Only appears if the probe wash mode has been selected. Use the arrow keys to select the time delay in seconds between the probe wash ending and control beginning again. The hold time can be programmed for a maximum of 99 seconds.
<b>HOA</b>	Use the Left and Right arrows to move between Hand, Off and Auto. In Hand (Manual) mode, the output will be turned on immediately at the maximum programmed rate for a maximum of 10 minutes. In the Off mode, the output will be turned off indefinitely. In the Auto mode, the output turns on and off in response to changes in the process value relative to the set point. The letter inside the block on the status screen indicates which mode the output is in.

Possible Status Screens

- Aux 1 A 1:05
- Aux 1 A OFF
- Aux 1 A PW

# Auxiliary 1 and 2 Menu

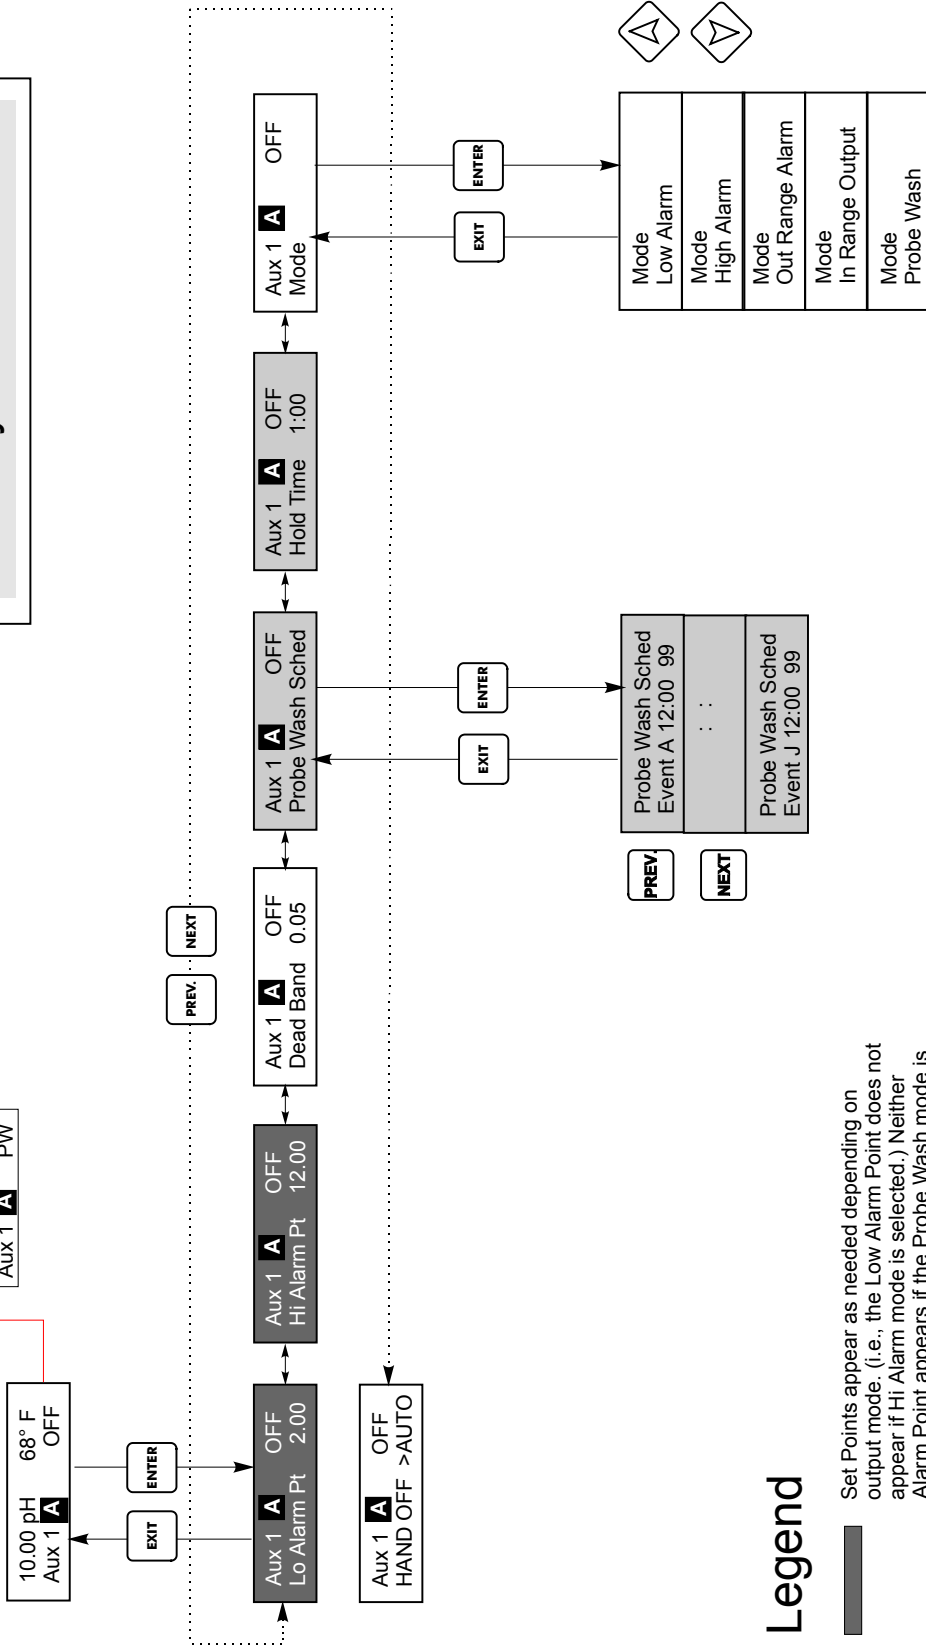

## Legend

Set Points appear as needed depending on output mode. (i.e., the Low Alarm Point does not appear if Hi Alarm mode is selected.) Neither Alarm Point appears if the Probe Wash mode is selected.

Menu choices that appear when Probe Wash mode is selected.

***Figure 12 Auxiliary 1 and 2 Menu***



## 5.7 4-20 mA Menu (Optional)

This menu will only appear if the optional 4-20 mA output board is installed. It is used to set the scale of the 4-20 mA output. It contains the following menu selections: Assign Inputs, 4 mA Point, 20 mA Point, and Calibrate.

Note: When programming the controller for the first time, first go to the Assign Inputs Menu, then program the other menus.

<b>Assign Inputs</b>	Press <b>ENTER</b> to assign the 4-20 mA output to a sensor input. Use the arrow keys to toggle between “pH/ORP” and “Temp.” Press <b>ENTER</b> when the desired choice is displayed.
<b>4 mA Pt</b>	Use the arrow keys to enter the process value (in either pH units, or mV if ORP) that you want to correspond to a 4 mA output from the controller.
<b>20 mA Pt</b>	Use the arrow keys to enter the process value that you want to correspond to a 20 mA output from the controller.
<b>Calibrate</b>	This menu is used to calibrate instruments connected to the mA output. The 4-20 mA output is extremely accurate and stable and therefore will never need calibration. This feature allows other devices to be calibrated at the 4 and 20 mA points. Press <b>ENTER</b> to start the calibration.
<b>Fixed 4 mA Out</b>	The controller will output 4.00 mA. Adjust the chart recorder or data logger per its instruction so that the process value displayed is what is expected for a 4.00 mA input.
<b>Fixed 20 mA Out</b>	As above, except that the controller will output 20.00 mA. The design of the 4-20 mA output is such that it should never need calibration. If the mA signal is not what it should be, call the factory for service.

### 4-20mA Menu

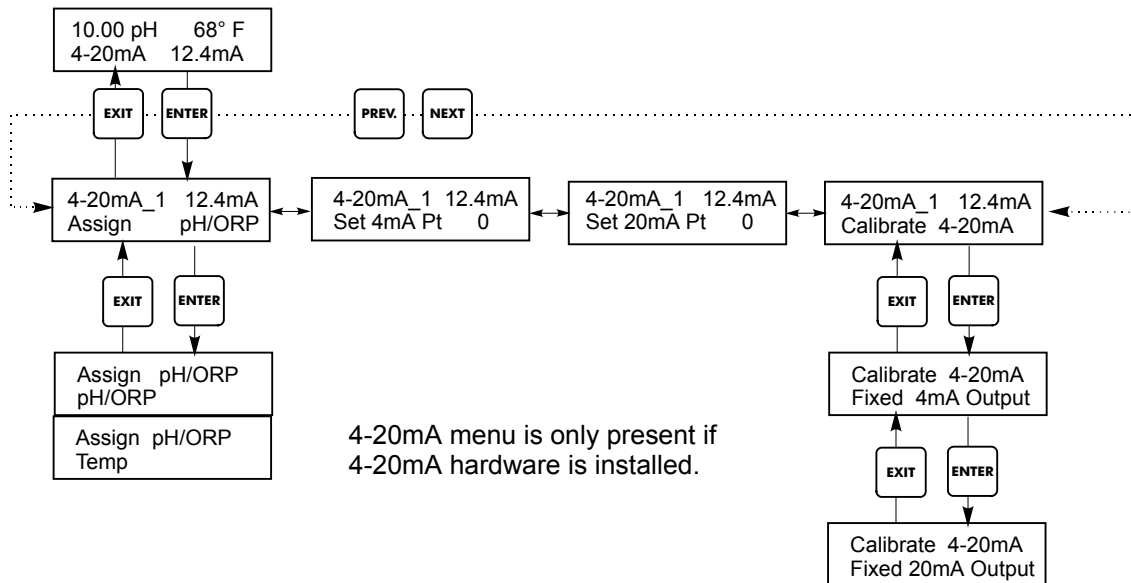


Figure 13 4-20 mA Menu

## 5.8 Time Menu

The time menu is used to set the date and time that the controller uses to schedule probe washing and calibration prompts. There is only one menu selection: Set Clock.

<b><i>Set Clock</i></b>	Press <b>ENTER</b> to set the clock. Use the arrow keys to change the year, date, and month, then press <b>ENTER</b> . Use the arrow keys again to set the day of the week and the time. Use military time (for example, 1:00 PM is 13:00). Press <b>ENTER</b> to return to the top level clock menu.
-------------------------	---



**Figure 14 Time Menu**

## 5.9 Access Code Menu

This menu determines whether the access code feature of the controller is enabled or disabled and allows you to customize the access code to your own value. The access code controls whether or not you are allowed to change the parameters in the controller. With the access code disabled, any user may change any parameter. With the access code enabled, any user can view any parameter, but cannot change them. Once an attempt is made to change a parameter, the display will prompt the user to enter the access code. If the correct access code is entered, the parameters can be changed. If the wrong access code is entered the parameters cannot be changed. Once the access code has been correctly entered, it will remain valid until there is a period of 10 minutes without a key being pressed. The access code menu will appear as shown below:


Access Code	<b>DIS</b>	Indicates that the access code is disabled. No access code is required to change any setting.
Access Code	<b>REQ</b>	Indicates that the access code is required to alter settings.
Access Code	<b>OK</b>	Indicates that the access code is required and has been entered correctly.

<b>Enable N / Y</b>	Press the Up or Down arrow key to change the N to Y and press ENTER to enable the access code feature. If the access code is enabled you must first enter the access code to disable it.
<b>New Value</b>	<p>Press ENTER to display the current access code value and use the arrow keys to change it to any value between 0 and 9999. If the access code has been enabled, you will be prompted to enter the current access code before being allowed to change it. You must remember the access code if you enable it.</p> <p>The Factory default Access code is 1995.            If you change the access code and can't remember it follow this procedure:</p> <ol style="list-style-type: none"> <li>1. Turn off power to the controller.</li> <li>2. Wait 10 seconds.</li> <li>3. Press and Hold the UP and DOWN arrow keys while turning on the power.</li> <li>4. Read the access code on the display.</li> <li>5. Release the keys, and the access code will disappear.</li> </ol>

# Access Code Menu

Any Top Display  
Access Code 0000

The Access Code prompt may appear at any screen in the entire menu structure if the current access code has not been entered by the user. Access code entries will be valid for 10 minutes from the most recent key press.

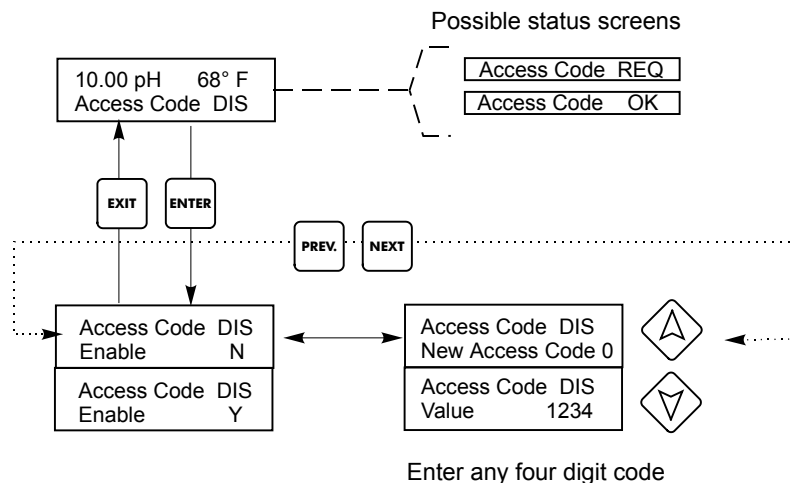


**Figure 15 Access Code Menu**

## 5.10 Datalog Menu

This menu is available if the data logging option has been purchased. This is indicated in the model code by the letter U at the end of the model code. This menu allows you to save data from the controller to a USB flash drive.

The controller has four logs, the Current Datalog, the Backup Datalog, the Event Log, and the Reset Log. All files are in a CSV format that may be opened in a spreadsheet such as Microsoft Excel.

<b>Current Datalog</b>	<p>Contains the following data taken at 10 minute intervals:          pH or ORP          Temperature (only for pH sensor types)</p> <p>When the current datalog is downloaded to a USB stick, it is erased and a new log file is started.          If the current datalog is not downloaded before it reaches its maximum size (at least 60 days of data) the oldest data is overwritten by the newest data.</p>	
<b>Backup Datalog</b>	<p>Contains the same data as the current log but it is never erased. When the backup log reaches its maximum size (at least 60 days of data), the oldest data is overwritten by the newest data.</p>	
<b>Event Log</b>	<p>Contains columns for each relay and flow switch input, as well as the date and time. Each time any of these change state, the date and time is updated and it will show a 1 if the relay is on and 0 if it is off, and a 1 if the flow switch indicates no flow, 0 if there is flow. Tens of thousands of events will be recorded before the oldest data is overwritten by the newest, the number varying with the controller's configuration.</p>	
<b>Reset Log</b>	<p>Consists of time stamps of when power was lost, when it was returned, and the cause of the reset.</p>	
<b>Current or Backup Datalog</b>	<p>Place a USB flash drive with at least 10 MB capacity into the USB port on the front panel of the controller. Press the Enter key to download the file from the controller to the disk. The file name for the Current Datalog will be Datalog&lt;serial number&gt;&lt;date&gt;&lt;time&gt;.csv using the date and time it was downloaded. The file name for the Backup Datalog will be Datalog&lt;serial number&gt;&lt;date&gt;&lt;time&gt;.csv using the date and time it was created.</p> <p>The controller will display the progress of the file download process. If the file was successfully copied to the USB disk the controller will display Transfer Success.</p>	
<b>Copy Event Log</b>	<p>Place a USB flash drive with at least 10 MB capacity into the USB port on the front panel of the controller. Press the Enter key to download the file from the controller to the stick. The file name will be Eventlog&lt;serial number&gt;&lt;date&gt;&lt;time&gt;.csv.</p> <p>The controller will display the progress of the file download process. If the file was successfully copied to the USB disk the controller will display Transfer Success, otherwise Transfer Fail 1.</p>	
	<b>Transfer Success</b>	<b>Transfer Fail 1</b>
<b>Copy Reset Log</b>	<p>Place a USB flash drive with at least 10 MB capacity into the USB port on the front panel of the controller. Press the Enter key to download the file from the controller to the stick. The file name will be Resetlog&lt;serial number&gt;&lt;date&gt;&lt;time&gt;.csv.</p> <p>The controller will display the progress of the file download process. If the file was successfully copied to the USB disk the controller will display Transfer Success.</p>	
	<b>Transfer Success</b>	<b>Transfer Fail 1</b>

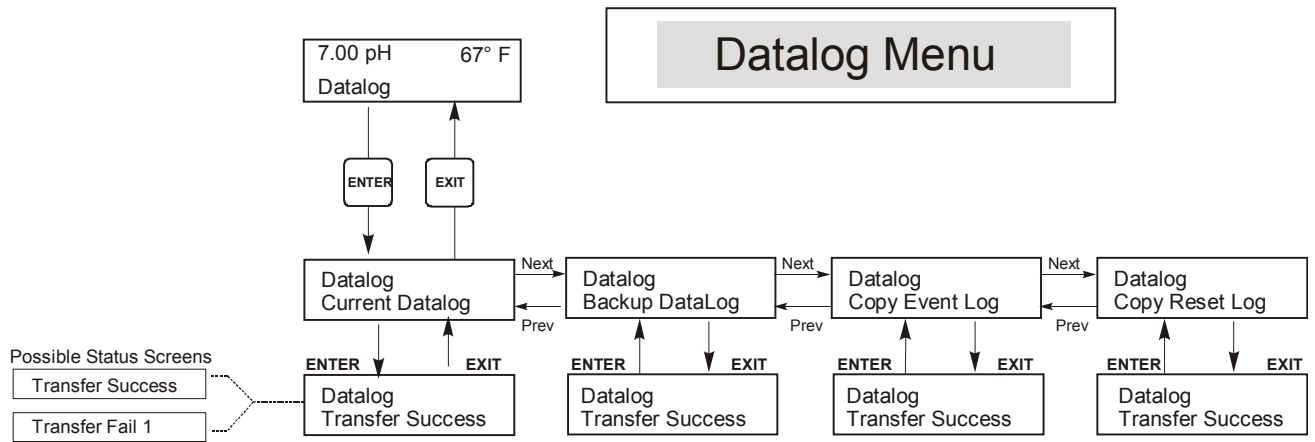


**Figure 16 Datalog Menu**

## 5.11 Config Menu

This menu allows you to export a file that contains all of the set points in the controller to a USB flash disk drive, and then later import the set points into another controller.

<b>Export Config</b>	Place a USB flash drive with at least 10 MB capacity into the USB port on the front panel of the controller. Press the Enter key to export the configuration file from the controller to the stick. The file name will be UCF.ini. If you are exporting files with different set points you may rename the file to something that describes it, as long as it has an ini extension.	
	The controller will display the progress of the file download process. If the file was successfully exported to the USB disk the controller will display Transfer Success, otherwise Transfer Fail 1.	
	<b>Transfer Success</b>	<b>Transfer Fail 1</b>
<b>Import Config</b>	Place a USB flash drive that contains only one configuration file stored on the root directory of the stick into the USB port on the front panel of the controller. Press the Enter key to import the configuration file from the stick to the controller. The file name must have an ini extension in its name.	
	The controller will display the progress of the file import process. If the file was successfully imported from the USB disk the controller will display one of the messages below:	
	<b>Import Failure</b>	Indicates that there were problems connecting to or accessing the USB stick.
	<b>Import Success: Any key to reboot</b>	The configuration file import succeeded and will be ready for use after reboot.
	<b>File Open Failed</b>	A config file could not be found on the USB stick or the USB stick file system could not be accessed.
	<b>File Read Failed</b>	The config file is too short (incomplete) or empty.
	<b>Invalid CFG File</b>	The imported file is not a valid config file.
	<b>Invalid Model</b>	The imported config file is not for this controller model.
	<b>Wrong SW Version</b>	The version of the imported config file is not compatible with this controller software version.
	<b>Corrupt CFG File</b>	The imported config file is corrupt. (The checksum failed.)
<b>Wrong file Size</b>	The size of the imported config file is wrong.	

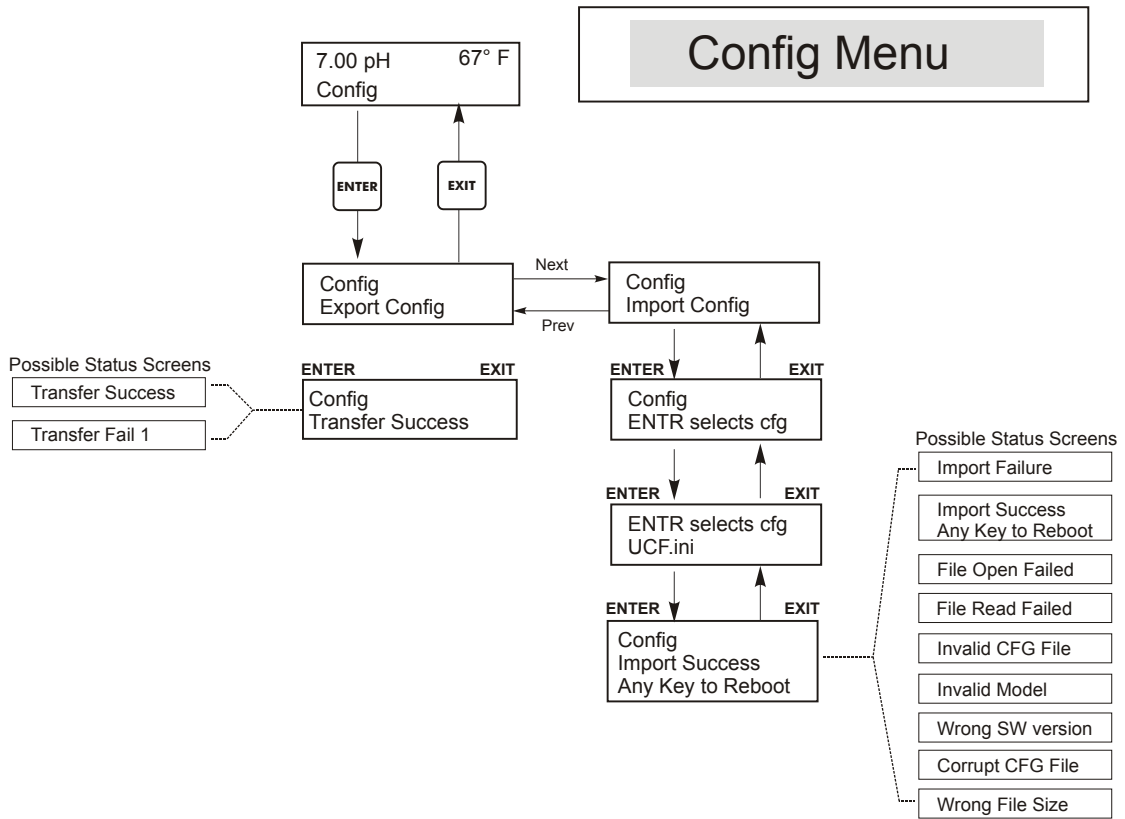

**Figure 17 Config Menu**


## 5.12 Upgrade Menu

This menu is used to upgrade the software to a newer version. If a new version of the software is available, an upgrade file will be posted on our web site. Save this file to a USB flash disk drive. It needs to be the only upgrade file stored on the root directory of the stick. Press the Enter key to import the software upgrade file from the stick to the controller.

The controller will display the progress of the file import process. If the file was successfully imported from the USB disk the controller will display Transfer Success. The controller will automatically reboot and come up with the new software installed.

<b>Upgrade</b>	The controller will display the progress of the file import process. If the file was successfully imported from the USB disk the controller will display Transfer Success. The controller will automatically reboot and come up with the new software installed. If the software upgrade fails, you will see one of the following messages:	
	<b>UpgradFileInvald</b>	The file found on the USB stick is for the wrong product, or is corrupt. Try getting the correct upgrade file and make sure it's the only upgrade file on the stick.
	<b>No Upgrade File</b>	There is no upgrade file stored on the stick, or the file is named incorrectly.
	<b>CorrptUpgradFile</b>	Try getting a new copy of the file.
	<b>Flash Failure</b>	The flash memory on the processor board has a problem. Repair or replace the front panel assembly.

To check that it was successful, turn off power to the controller, then press the Enter key while turning power on. The controller will show the software version, which should match the name of the upgrade file that you used.

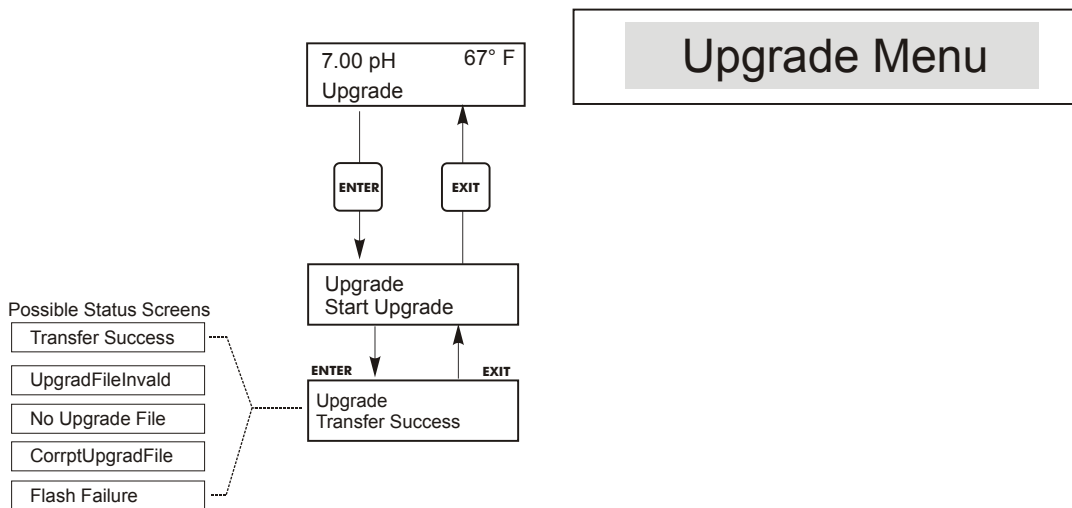

**Figure 18 Upgrade Menu**



## 6.0 MAINTENANCE

---

The WPH control module itself needs very little maintenance. Clean the outside of the controller enclosure with a damp cloth. Do not spray down the controller unless the enclosure door is closed and latched. "Pigtails" should be protected from spray or wash-down. Check the cords and cables for damage.

### 6.1 Electrode Maintenance

The pH or ORP electrodes require periodic cleaning and calibration. These electrodes are like batteries and their voltage outputs will change with time even if they are not being used. After installation, the rate of change increases, and factors such as temperature, extremes of pH, abrasion and chemical attack will increase the required frequency of calibration. If the process solution contains oils, scale or other solids, the electrode surfaces will tend to coat, its response time will slow down and cleaning will be required.

The frequency of cleaning and calibrating will vary greatly depending upon the application, the factors listed above, as well as the accuracy of control you require. The best way to determine the optimum number of days between calibrations is to remove the electrode from the process periodically (weekly in clean water applications, daily in dirty or hot applications) and check its accuracy in a buffer solution. If using manual temperature compensation, remember to change the temperature from that of the process to that of the buffer. If the accuracy of the reading is within your required tolerances, and the speed of response is good, replace the electrode in the process. If not, clean the electrode and perform a two point calibration.

The method of cleaning the electrode will depend upon the coating, as well as the materials of construction of the electrode. Do not use a solvent that will attack the electrode! Care must be taken to avoid scratching the pH electrode's glass, as this will shorten its life. An ORP electrode's platinum surface may be cleaned with 600 grit silicon carbide paper, jewelers rouge or very fine steel wool.

Oily coatings should be removed with a mild detergent or isopropyl alcohol. Hard scales such as calcium carbonate can usually be removed with a dilute hydrochloric acid solution. Soft coatings can be removed using a soft cloth or soft toothbrush.

A two point calibration should always be performed after cleaning the electrode.

Because the electrode signal is so sensitive, the condition of the cable and connectors between the electrode, preamplifier and controller is critical. Make sure that all electrical connections stay clean and dry. Never splice the cable prior to preamplification. Replace the cable if there is any sign of damage.

## 6.2 Replacing the Fuses



**CAUTION:** Disconnect power to the controller before opening front panel!

Locate the fuses on the circuit board at the back of the controller enclosure. (See figure 4.) Gently remove the old fuse from its retaining clip and discard. Press the new fuse into the clip, secure the front panel of the controller and return power to the unit.

**Warning:** Use of non-approved fuses can affect product safety approvals. Fuse ratings depend on controller power rating. Specifications are shown below. To insure product safety certifications are maintained, it is recommended that a Walchem fuse be used.

F1 Fuse	Walchem P/N	F2 Fuse (WPH410 only)	Walchem P/N
5 x 20 mm, 1.0A, 250V	103163	5 x 20 mm, 6A, 250V	102864

## 7.0 TROUBLESHOOTING



**CAUTION:** Disconnect power to the controller before opening front panel!

Troubleshooting and repair of a malfunctioning controller should only be attempted by qualified personnel using caution to ensure safety and limit unnecessary further damage. Contact the factory.

### 7.1 Error Messages

#### Output Timeout

This error message appears if one of the control outputs has been on longer than the maximum amount of time programmed in the "Time Limit" menu found in the "Control 1" or "Control 2" menus. It is reset by answering "Yes" to the "Reset Timer" prompt that will appear. There are a number of possible reasons that the output could go on for longer than normal:

Possible Cause	Corrective Action
The process went further out of control than normal.	Increase time limit or reset timer.
The chemical supply has run out.	Replenish the chemical supply.
The pump or valve or supply line is faulty.	Repair or replace the control device.
Wrong chemical is being controlled.	Replace with correct chemical.
The electrode is not responding to changes.	Replace electrode, cable or preamplifier. Evaluate mixing or recirculation.

## High Alarm

This error message appears if the pH/ORP reading exceeds the set point for one of the AUX outputs that has been configured as a high alarm output. There are a number of possible causes for this condition:

Possible Cause	Corrective Action
The process went further out of control than normal.	May have to increase chemical flow rate.
The chemical supply has run out.	Replenish the chemical supply.
The pump or valve or supply line is faulty.	Repair or replace the control device.
Wrong chemical is being controlled.	Replace with correct chemical.
The electrode is not responding to changes.	Replace electrode, cable or preamplifier. Evaluate mixing or recirculation.
The pump is siphoning, valve leaking.	Repair or replace the control device or re-route tubing.
Control output has been left in "HAND" mode.	Switch back to "AUTO".
It may be a normal part of the process.	None required.

## Probe Error

This error message appears if the pH/ORP input signal is outside of the normal range. This usually indicates that the electrode has been disconnected or is faulty. It could appear under normal conditions if the pH is outside of the operating range of -2 to 16pH, or if the ORP is outside of the normal range of  $\pm 1500$  mV.

Possible Cause	Corrective Action
Controller is faulty; fails self test (see section 5.2)	Re-check pH self test with preamp disconnected. If it still fails, send controller back for repair. If it passes, preamp is faulty.
Preamplifier has no power to it.	If battery powered preamp, replace battery. If preamp is powered by our controller, check +5V, -5V terminals vs COM terminal. Should read +5VDC $\pm 5\%$ and -4.6 VDC $\pm 5\%$ .
Preamplifier is faulty.	Indicated if $\pm 5$ VDC power out of spec w/preamp attached, but in spec without preamp attached. Repair or replace preamp.
Electrode is faulty.	Replace electrode.

## Interlock

This error message indicates that control has been stopped because the closed contact signal from a flow switch or level switch is now open and one or more control outputs have been programmed to interlock.

Possible Cause	Corrective Action
Flow has stopped, level too low.	May be a normal condition, otherwise restore flow or level.
Flow, level switch disconnected.	Reconnect.
Flow, level switch faulty.	Verify that switch closes using an ohmmeter. If not, repair or replace.
Controller faulty.	Verify that error message disappears if controller flow switch input is shorted. If not, repair controller.

## Calibration Time

This message appears to prompt you to perform the routine maintenance of cleaning and calibrating the electrode. It does not appear based upon any analysis of the condition of the electrode. The frequency of calibration is set by the user in the "Days Between Cal" menu found in the "Sensor" menu. If you do not want to be prompted to perform a calibration, set this menu to "0".

## Low Alarm

As above for "High Alarm", except that the pH/ORP reading is below the set point of one of the AUX outputs that has been set up as a low alarm output. Refer to the possible causes and corrective actions listed above for the "High Alarm" error message.

### **Out Range Alarm**

This error message appears if the pH/ORP reading is outside of the range selected for one of the AUX outputs that has been programmed as an "Out of Range Alarm". Refer to the possible causes and corrective actions listed above for the "High Alarm" error message.

### **In Range Output**

This error message appears if the pH/ORP reading is inside of the range selected for one of the AUX outputs that has been programmed as an "In Range Alarm". Refer to the possible causes and corrective actions listed above for the "High Alarm" error message.

### **Temp Sensor Err**

This error message appears if the signal from the automatic temperature compensation element disappears during operation. It is usually caused by a failure of the platinum RTD, or by a problem with the cabling or connections of the cable.

The Pt1000 RTD should read 1000 ohms at 0°C and 3.85 ohms/degree C above zero. At 25°C it should read 1096.25 ohms ±1%. A higher reading or open circuit (infinite resistance) may indicate a bad connection. A lower reading may indicate a shorted cable.

Measure the resistance at each connection between the sensor and the controller to determine if the sensor, cabling or connections are faulty.

### **Check Set Points**

This is a normal display if you have changed the choice of sensor from pH to ORP or vice versa. The default set points for each choice is different, and will not match what you need for your application. Always select the sensor type before setting the control or auxiliary output set points.

## **8.0 SERVICE POLICY**

---

The WPH Series pH/ORP Controller has a 2-year warranty on electronic components and a 1-year warranty on mechanical parts (keypad, terminal strip and relays).

We stock circuit boards for immediate exchange after we have isolated the cause of the problem.

Factory authorized repairs that are received by next-day-air will be returned within 24 hours. Normal priority for returns is two weeks.

Out of warranty repairs or circuit board exchanges are done on a flat fee basis after the warranty is expired.